

Comparing the Energy Requirements of Hot Water Circulation System Control Strategies: Preliminary Results

**RESNET 2016
February 29 – March 2, 2016**

Gary Klein
Gary Klein and Associates

Tel: 916-549-7080
Email: Gary@GaryKleinAssociates.com

Learning Objectives

1. Understand the control strategies for hot water circulation systems
2. Learn about a test setup that is being used to compare the water, energy and time performance of the control strategies.
3. Examine the patterns in the data coming from this test.
4. Begin the comparison of the energy performance of several of the control strategies.

The Test House – 2-story, 3,200 sf



Water Heater, Circulation Pump and Controls – as installed



Circulation Pump and Controls – as Installed



Water Heater, Circulation Pump and Controls – as of April 2014



Test Stand for Circulation Pumps and Control Strategies



The Theory

Hot Water Circulation Systems

There are six types of circulation systems:

- Thermosyphon (gravity convection with no pump),
- Continuously pumped systems,
- Timer controlled,
- Temperature controlled,
- Time and temperature controlled, and
- Demand controlled.

Given the same plumbing layout,
all of these systems will waste the same amount
of water at the beginning of a hot water event.

The difference in these systems
is in the **energy** it takes to keep the trunk line
primed with hot water.

Operating Costs of Circulation Loops

- Pump
- Heat loss in the loop
- Maintenance
 - Failure of the pump
 - Incorrect control settings
 - Pipe leaks
- What percent of the energy costs are due to the pump? To the losses in the loop?

Determination of Heat Loss in Circulation Loops

- You could measure the pipe lengths, diameters, insulation and environmental conditions and calculate the heat loss, if you can get to all of it!
- Or you could measure flow rate and the difference in temperature between the water leaving from, and returning to the water heater.

Heat Loss in Circulation Loops – Calculation for Loop Losses Only

Sample Calculation: 1 gpm and 1°F temperature drop

- $\text{Energy} = m * c_p * (T_{\text{hot}} - T_{\text{return}}) = \text{Btu}$
- $1 \text{ gpm} * 8.33 \text{ pounds per gallon} * 1 * 60 \text{ minutes per hour} * 1^\circ\text{F} = 500 \text{ Btu/hour/}^\circ\text{F}$

Natural Gas Water Heater

- $500 \div 0.75 \text{ efficiency} = 667 \text{ Btu/hour/}^\circ\text{F}$
- $667 \div 100,000 \text{ Btu/Therm} = 0.00667 \text{ Therm/hour/}^\circ\text{F}$
- $0.00667 * \$1.00/\text{Therm} = \$0.00667/\text{hour/}^\circ\text{F}$

Electric Water Heater

- $500 \div 0.98 \text{ efficiency} = 510 \text{ Btu/hour/}^\circ\text{F}$
- $510 \div 3,412 \text{ Btu/kWh} = 0.15 \text{ kWh/hour/}^\circ\text{F}$
- $0.15 * \$0.10/\text{kWh} = \$0.015/\text{hour/}^\circ\text{F}$

Annual **Energy Use** for a Circulation System Attached to a Gas Water Heater (Therms)

Continuous Pumping at 1 Gallon Per Minute				
	Temperature Drop in °F			
Days	1	5	10	20
1	0.16	0.80	1.60	3.20
30	5	24	48	96
365	58	292	584	1,168
Pump Flow Rate in Gallons Per Minute				
1	58	292	584	1,168
5	292	1,460	2,920	5,840
10	584	2,920	5,840	11,680
Steady state heat transfer efficiency is assumed to be 75%.				

Electrical energy to operate the pump is additional

Annual **Energy Use** for a Circulation System Attached to an Electric Water Heater (kWh)

Continuous Pumping at 1 Gallon Per Minute				
	Temperature Drop in °F			
Days	1	5	10	20
1	3.60	18.00	36.00	72.00
30	105	525	1,050	2,100
365	1,278	6,388	12,775	25,550
Pump Flow Rate in Gallons Per Minute				
1	1,278	6,388	12,775	25,550
5	6,388	31,938	63,875	127,750
10	12,775	63,875	127,750	255,500
Steady state heat transfer efficiency is assumed to be 98%.				

Electrical energy to operate the pump is additional

When Do You Not Want to Operate a Hot Water Circulation Pump?

- When you don't need hot water
 - When you aren't there
 - When you are sleeping or doing something else
- When you are using hot water

The only time you want to operate the pump is just before you need hot water.

Use Demand Controlled Circulation

- The pump will run less than ½ hour per day
 - The most energy efficient option.

Energy to Operate a Circulation Loop

	Recirculation						Demand Controlled Priming
	Daily Hours of Operation						
	24	12	8	6	4	2	
0.25							
Loop Heat Losses							
Natural Gas (therms)	292	146	97	73	49	24	3
Electric (kWh)	6,388	3,194	2,129	1,597	1,065	532	67
Pump Energy(kWh)	438	219	146	110	73	37	8

Loop is assumed to be 100 feet long.

50 feet supply, 50 feet return

Recirculation:

Flow rate is 1 gpm

Temperature drop is 5F

50 watt pump

Demand Controlled Priming:

85 watt pump


The Practice

Control Strategies Being Tested


The intent is to determine the energy it takes to provide hot water quickly anywhere, anytime, regardless of changing schedules

- Continuous Circulation
- Aquastat – Low, Medium and High Speed
 - 85-105F, 105-115F
- Intermittent Pulsed Timer
- Demand Controlled
- Other – Aquastat and Timer, Memory


Continuous Circulation: Medium Speed

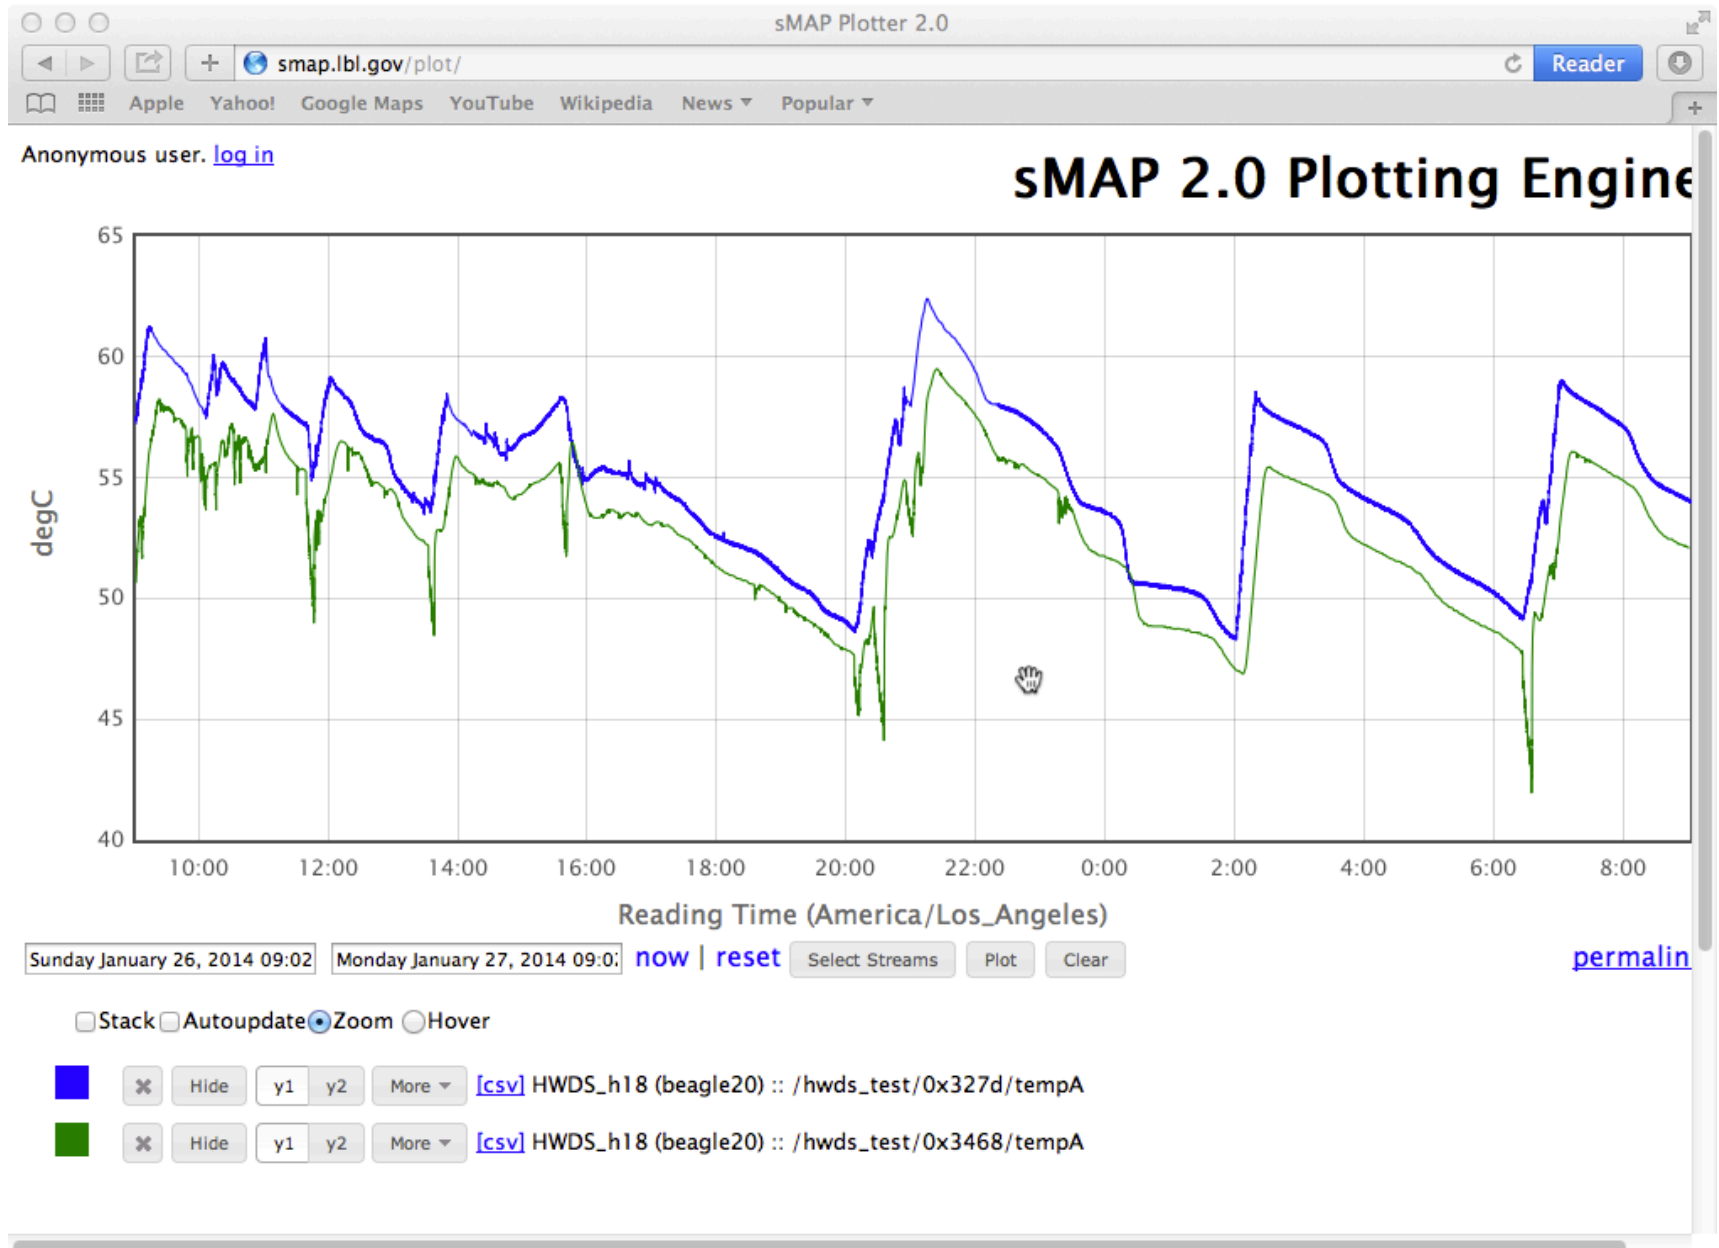


Continuous Circulation: Low Speed

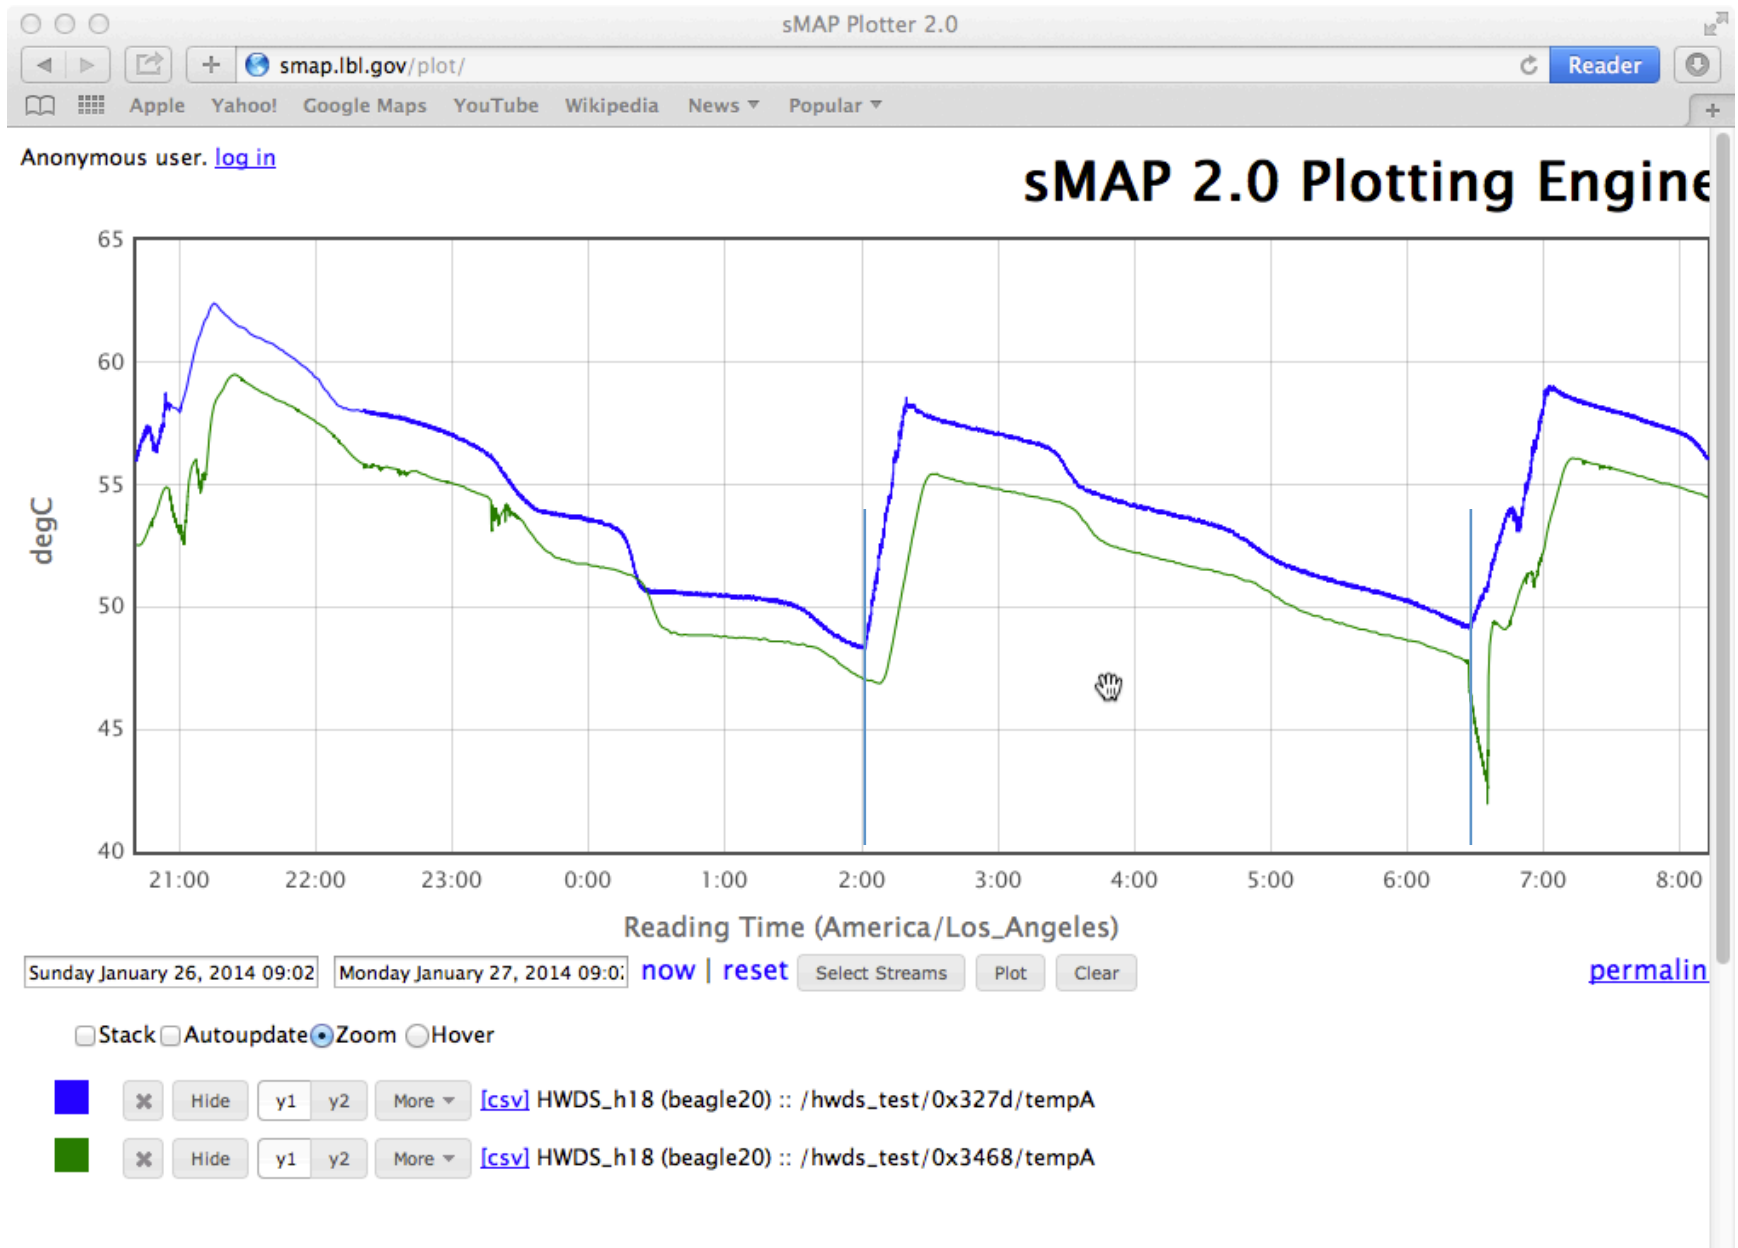


Continuous Circulation: Medium Speed

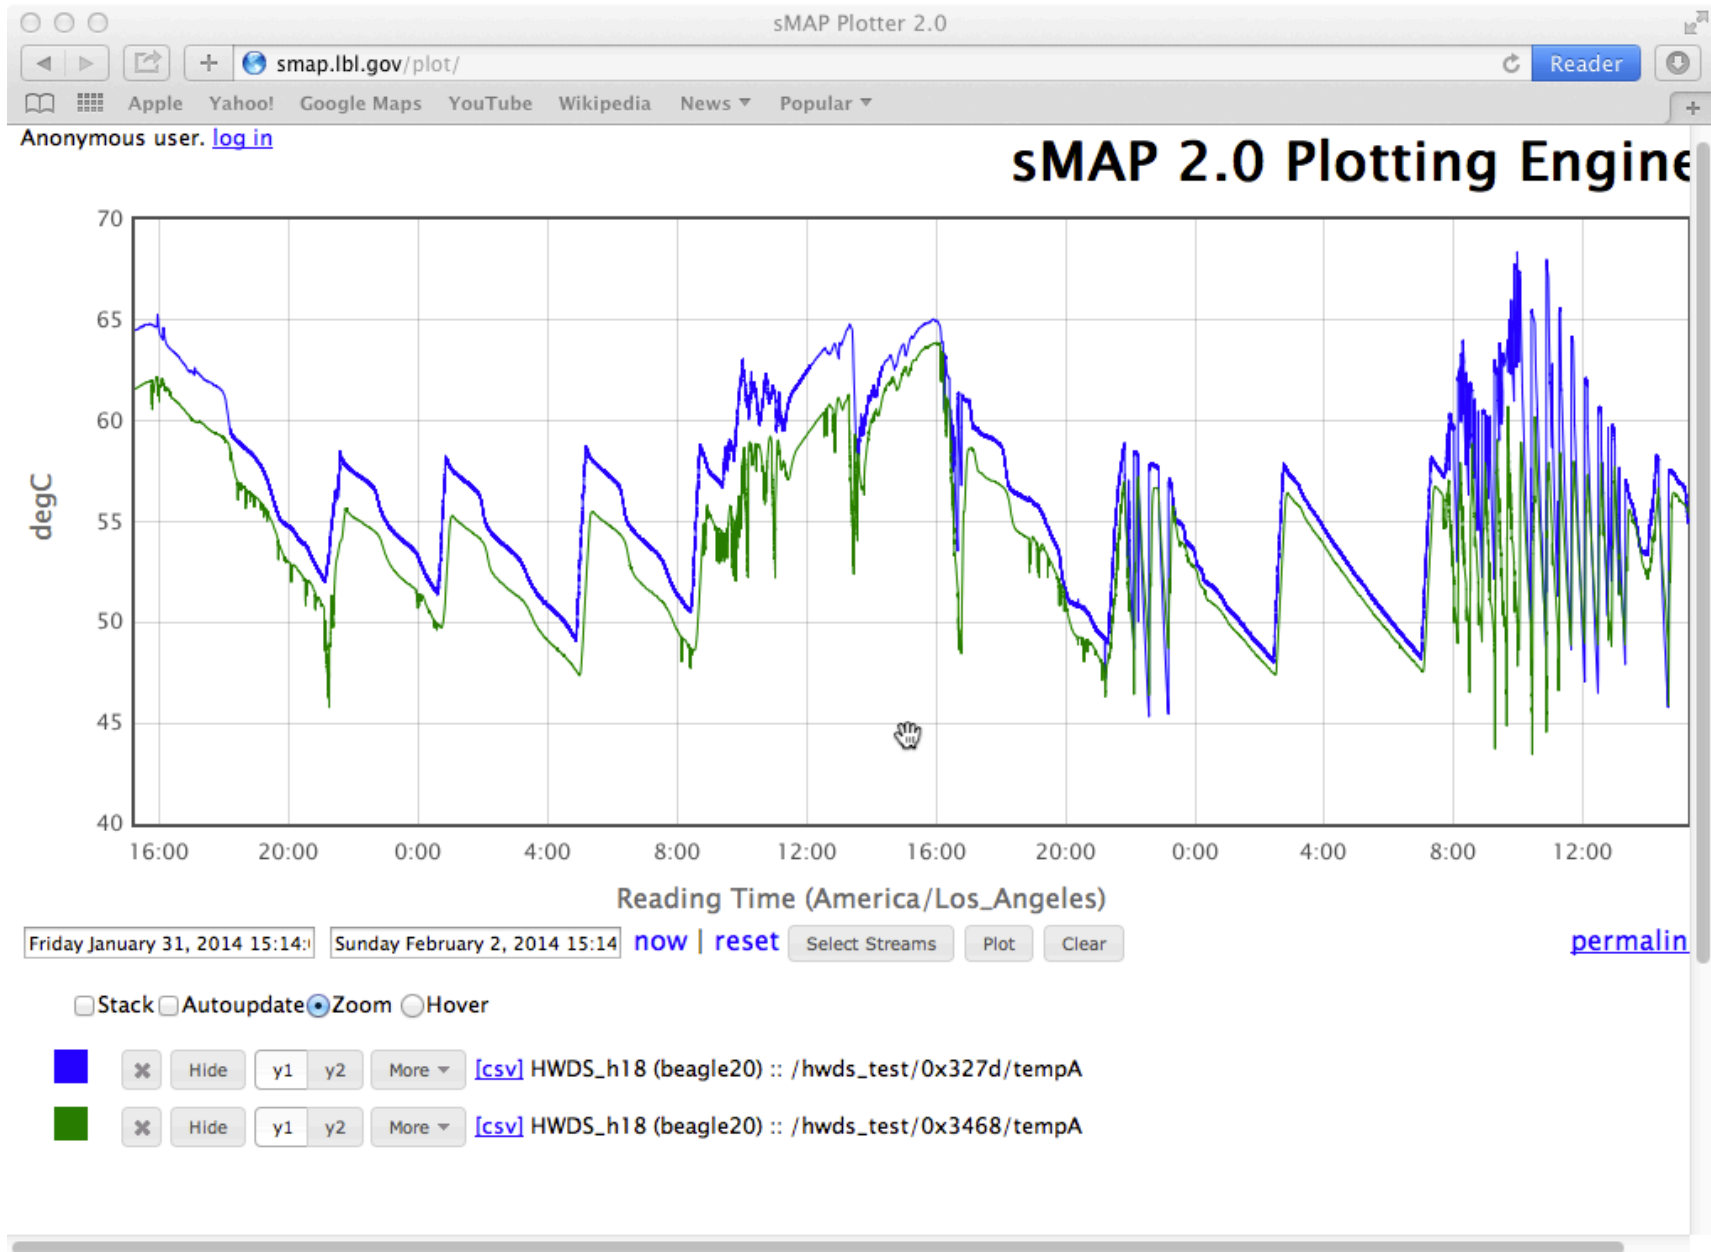


Continuous Circulation: Medium Speed

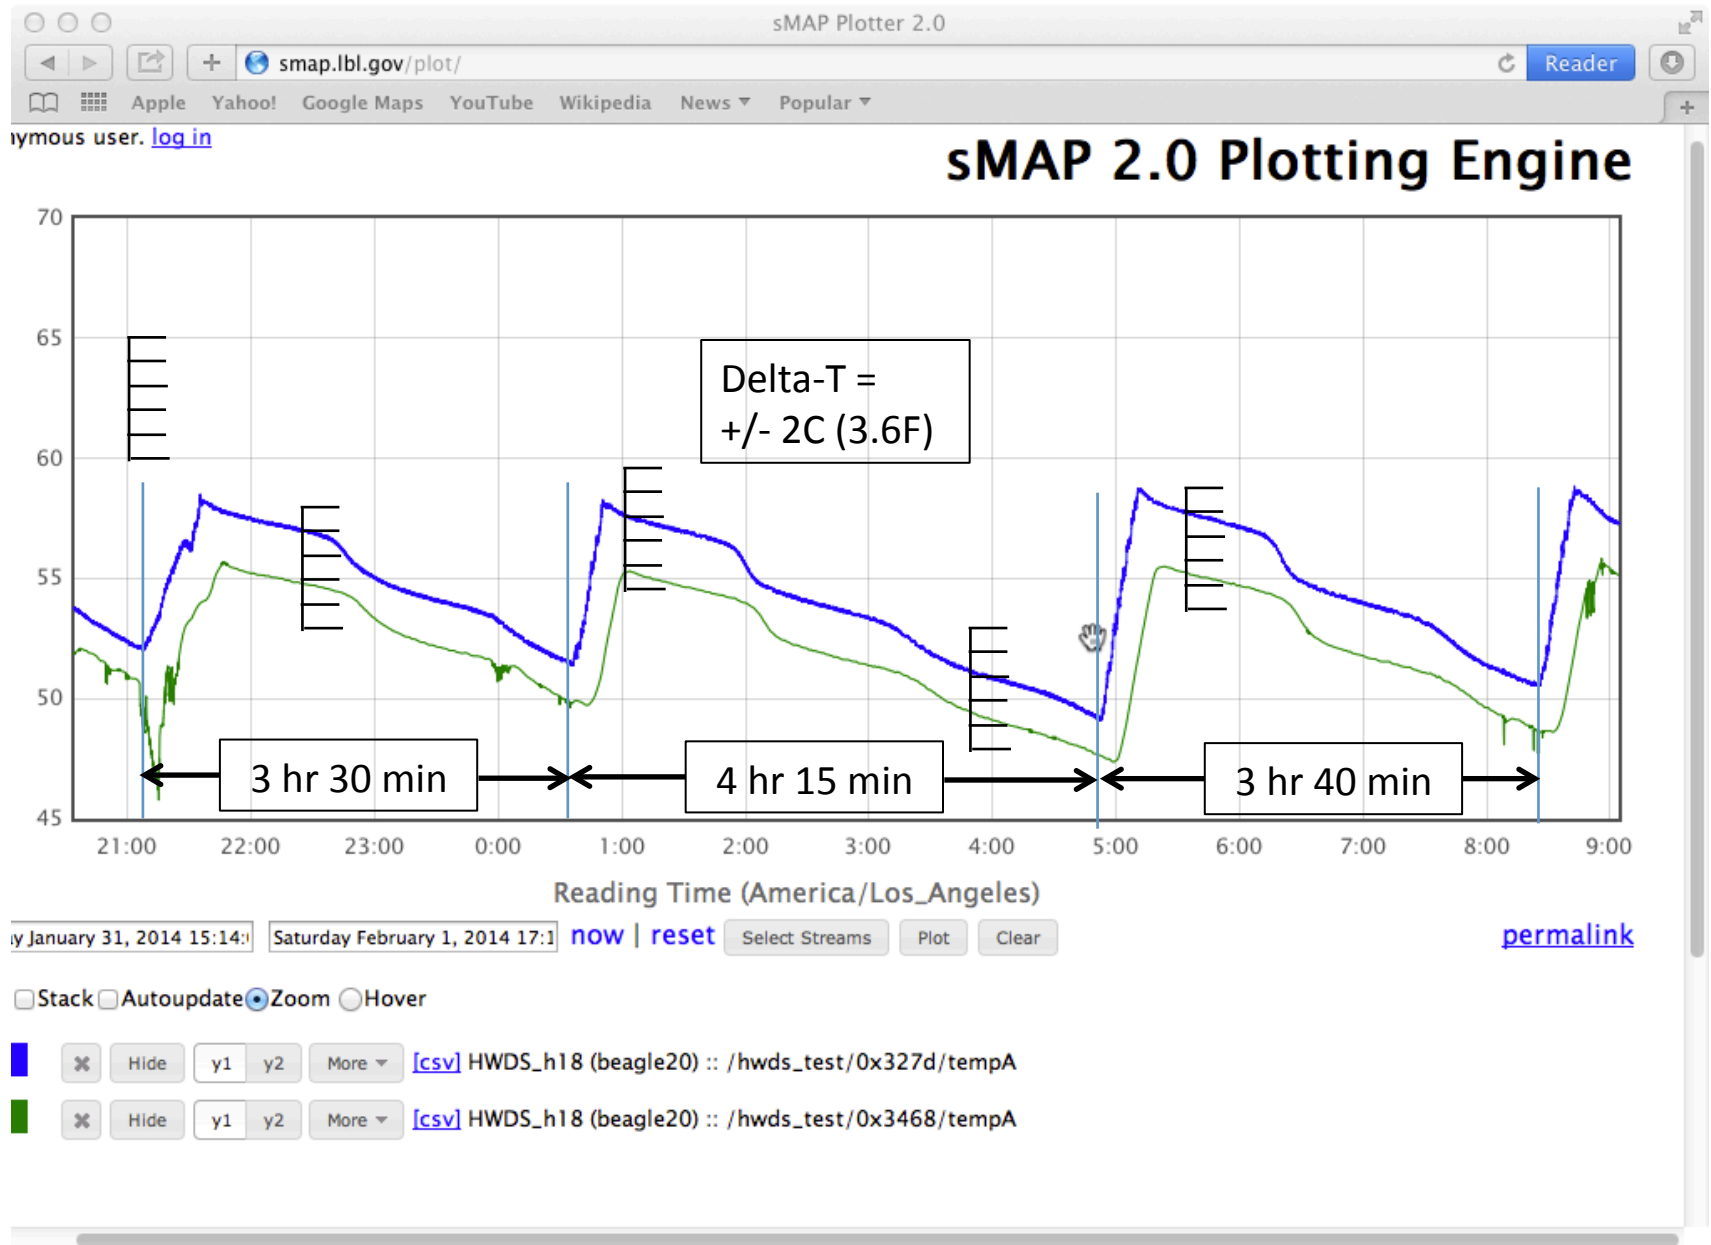


Intermittent Pulsed Timer

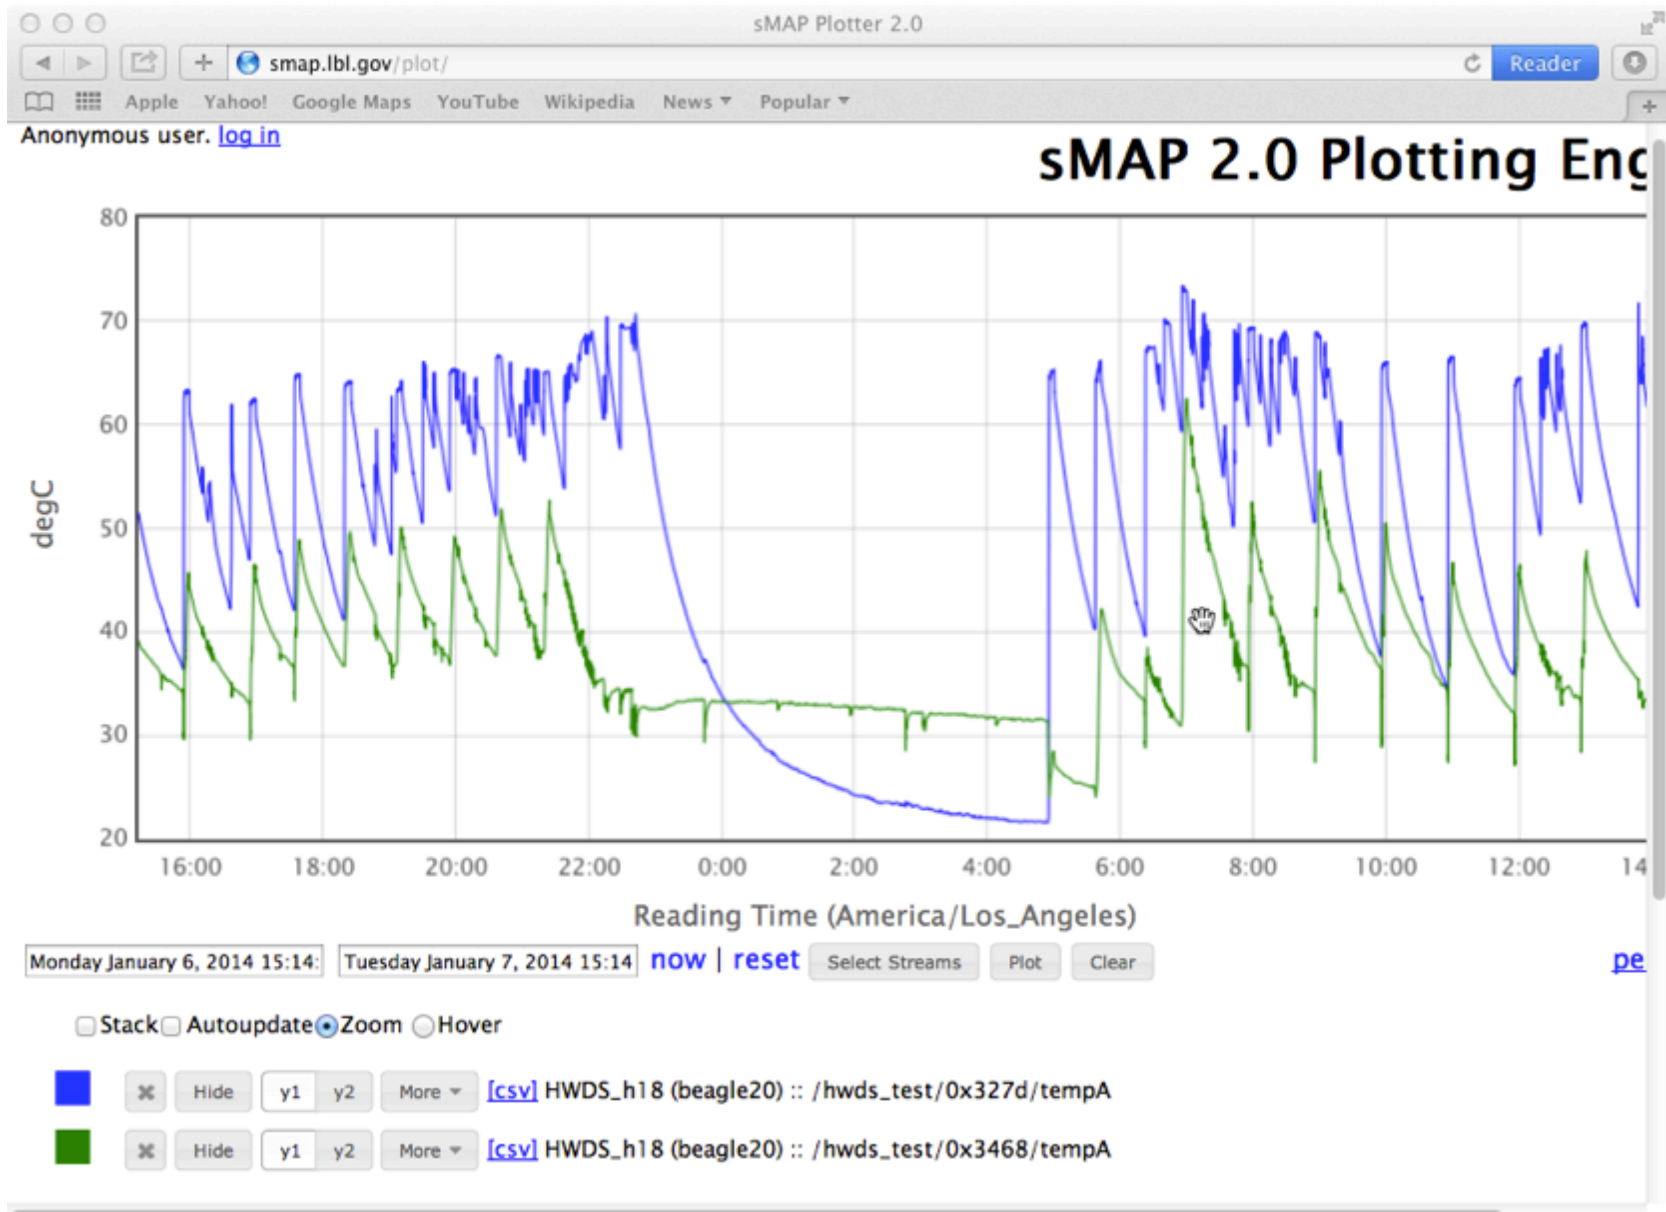


Intermittent Pulsed Timer

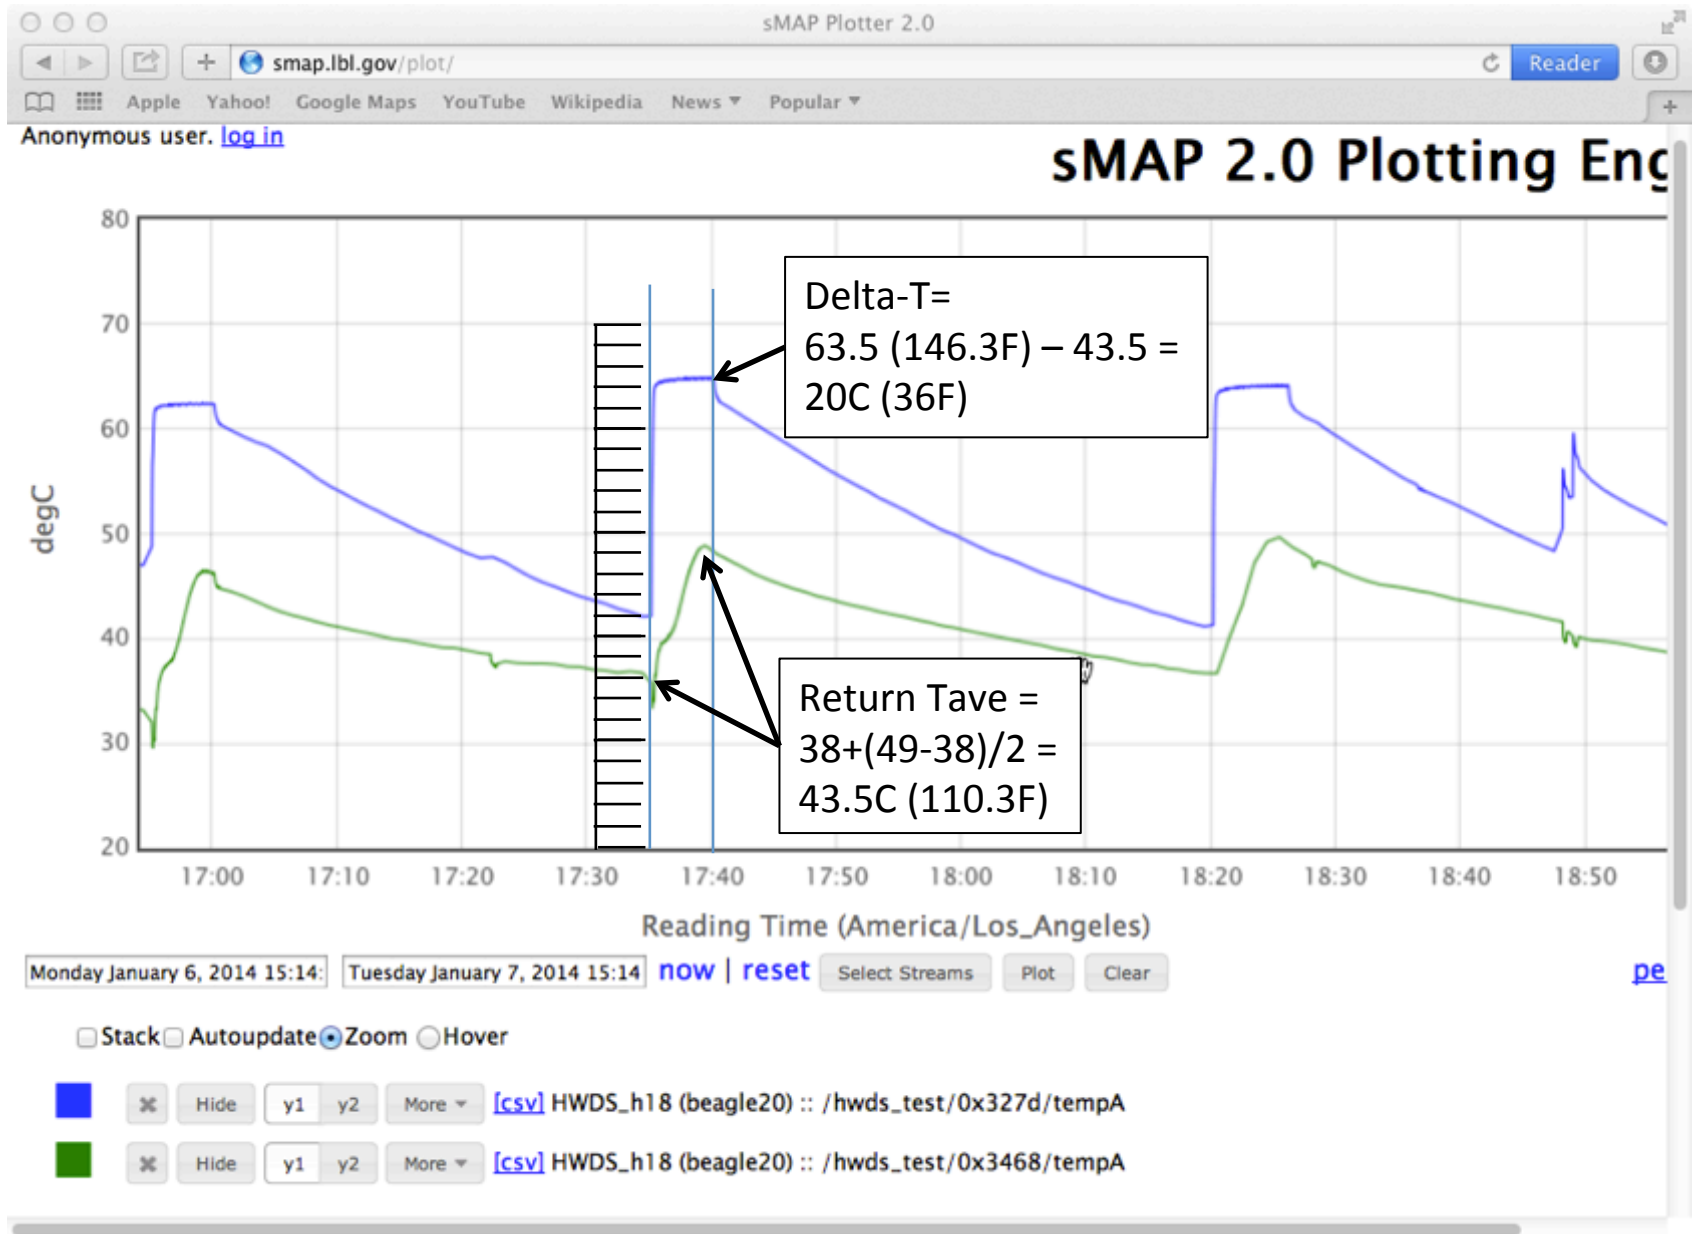


Aquastat: 85-105F, Medium Speed

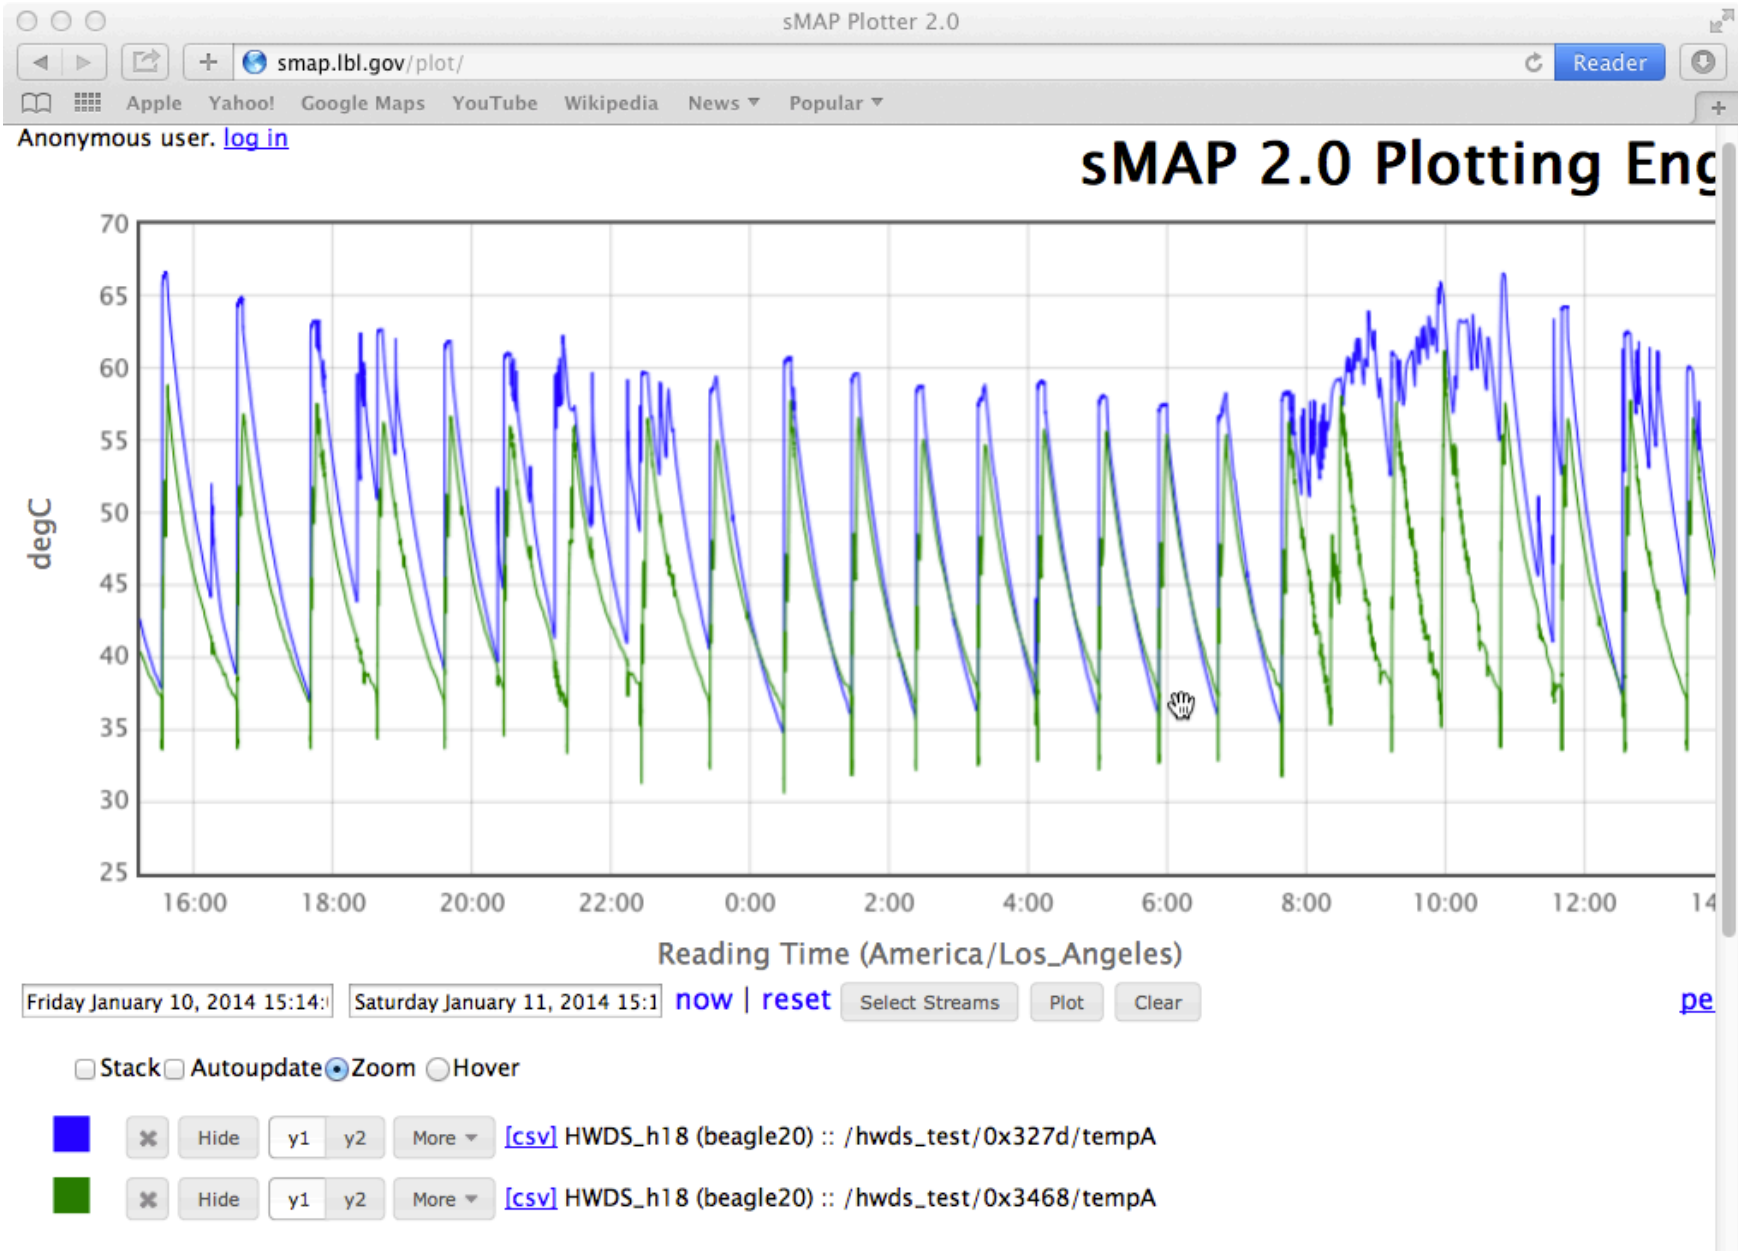


Aquastat: 85-105F, Medium Speed

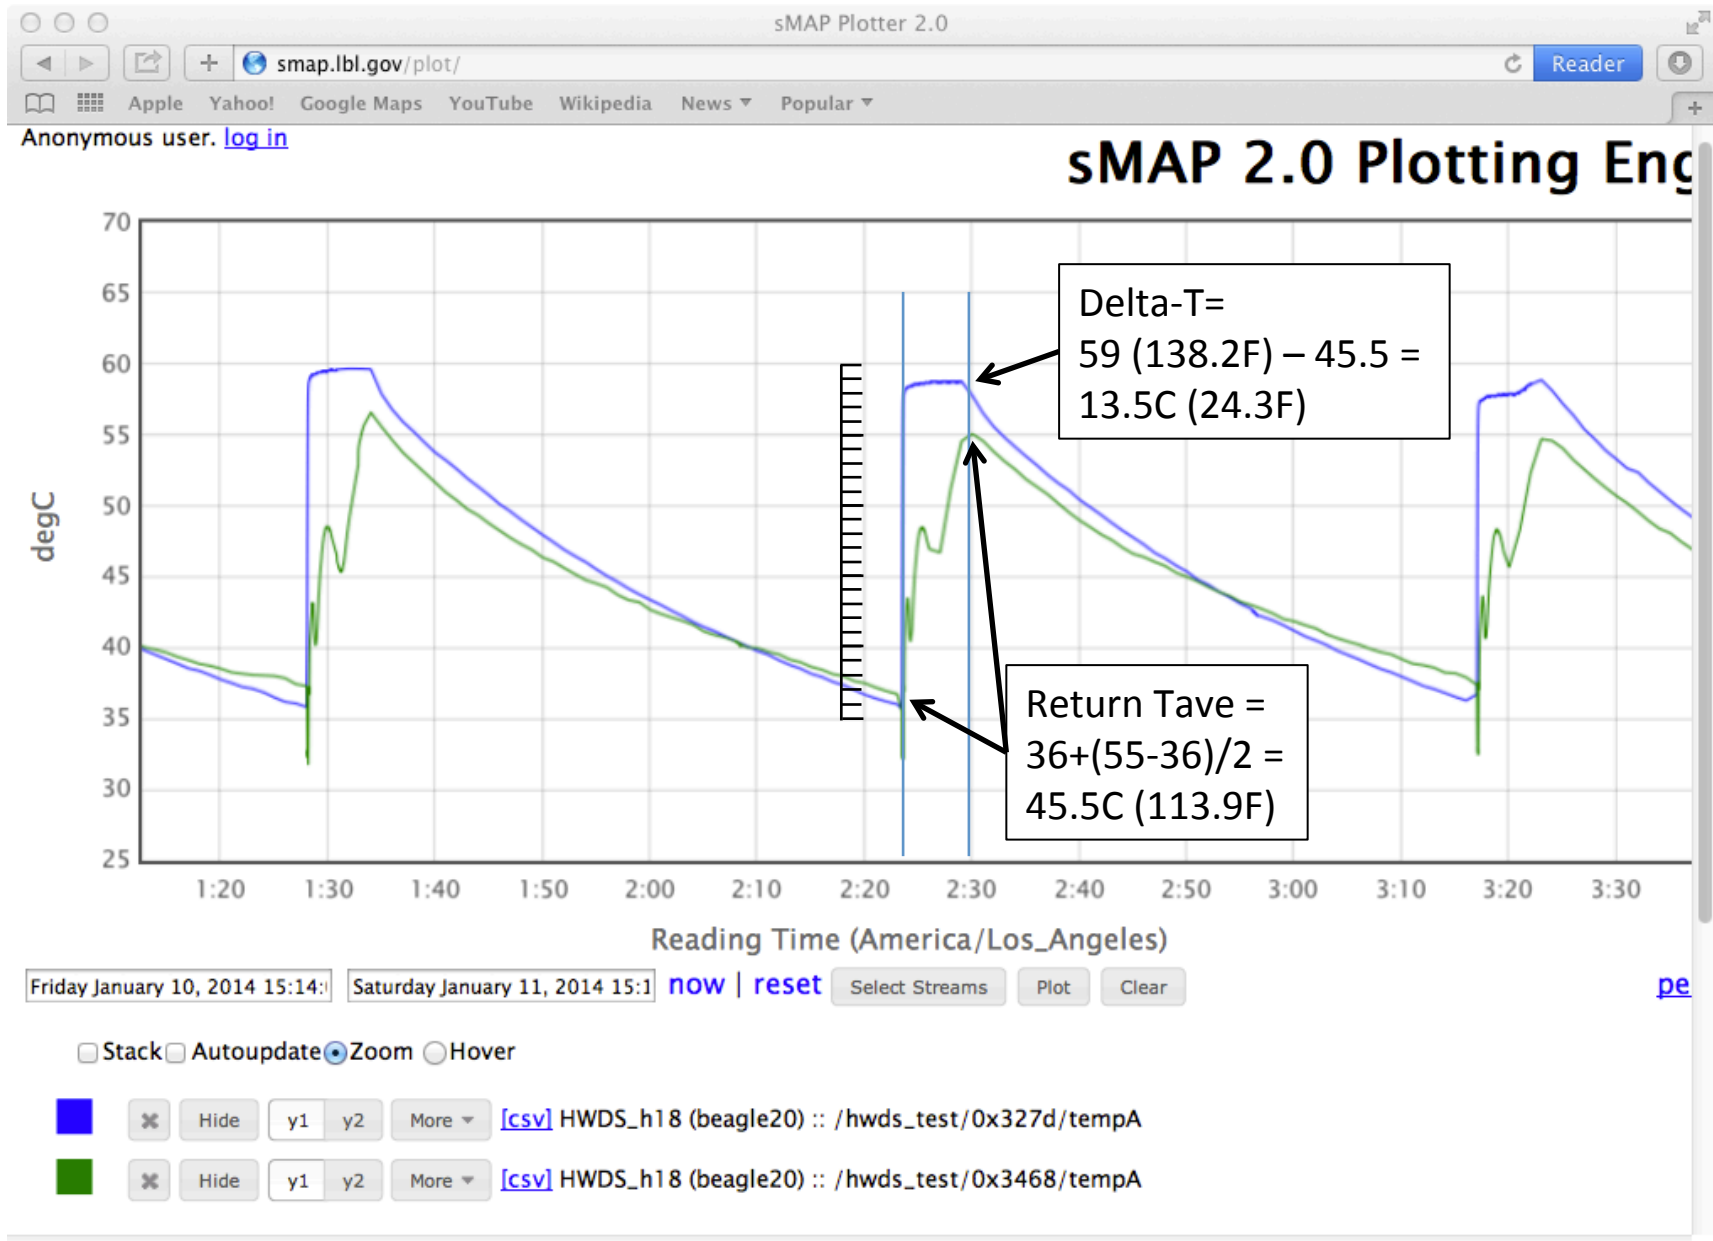


Aquastat: 85-105F, High Speed

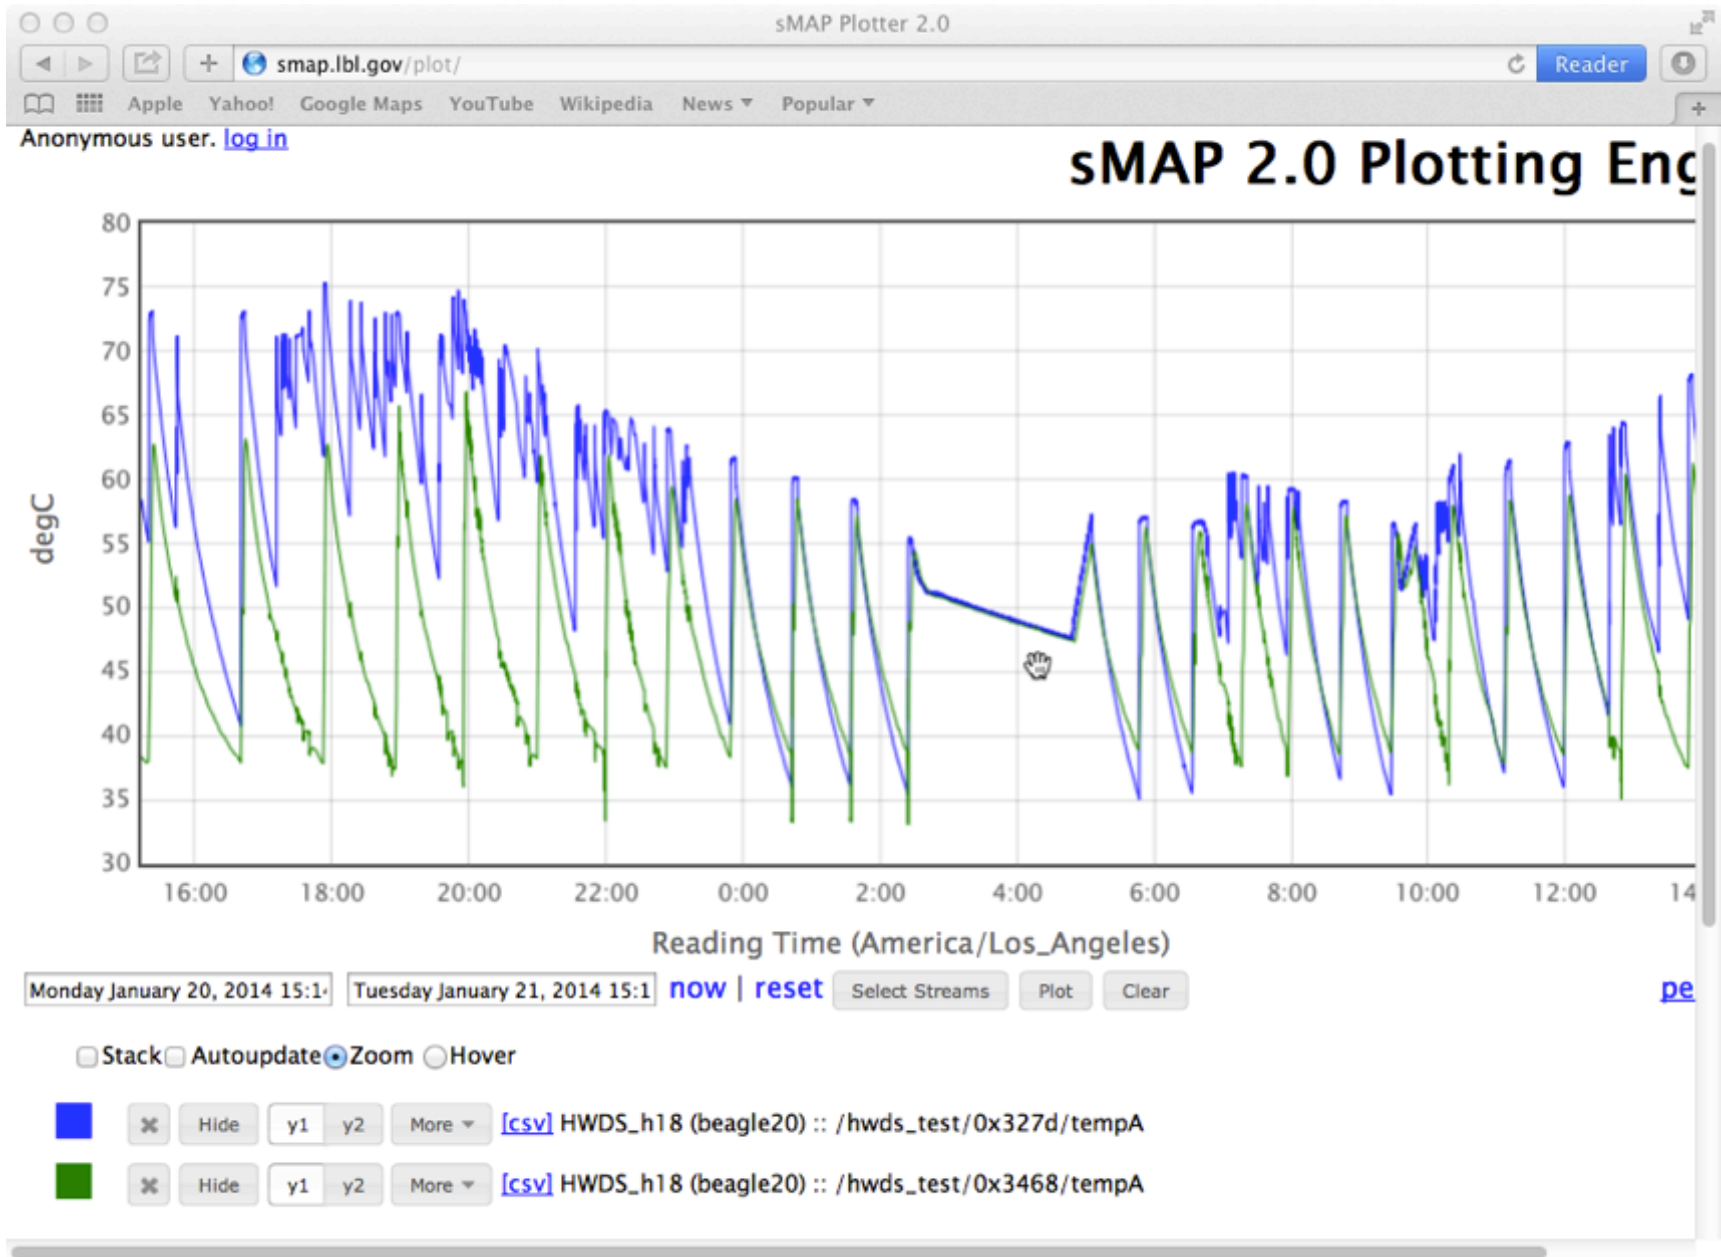


Aquastat: 85-105F, High Speed

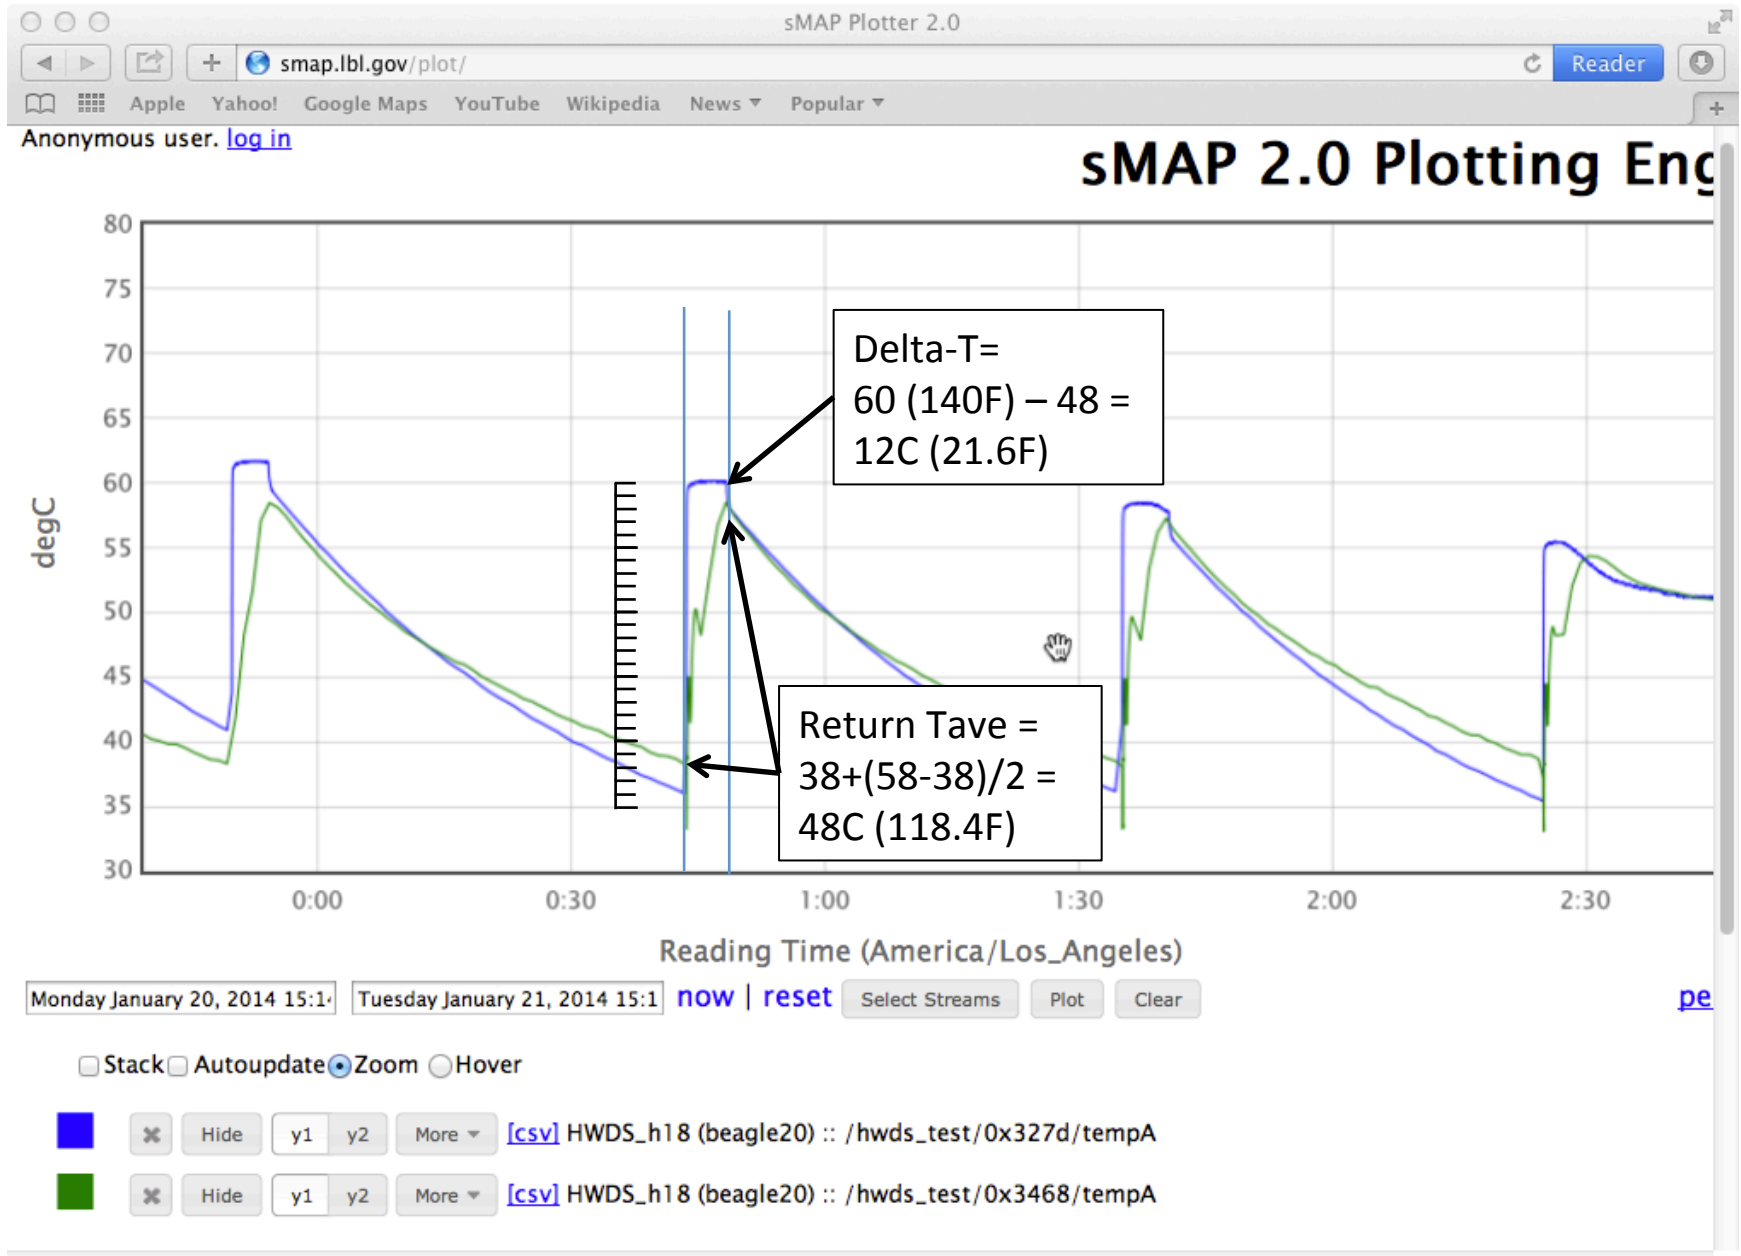


Aquastat: 105-115F, Medium Speed

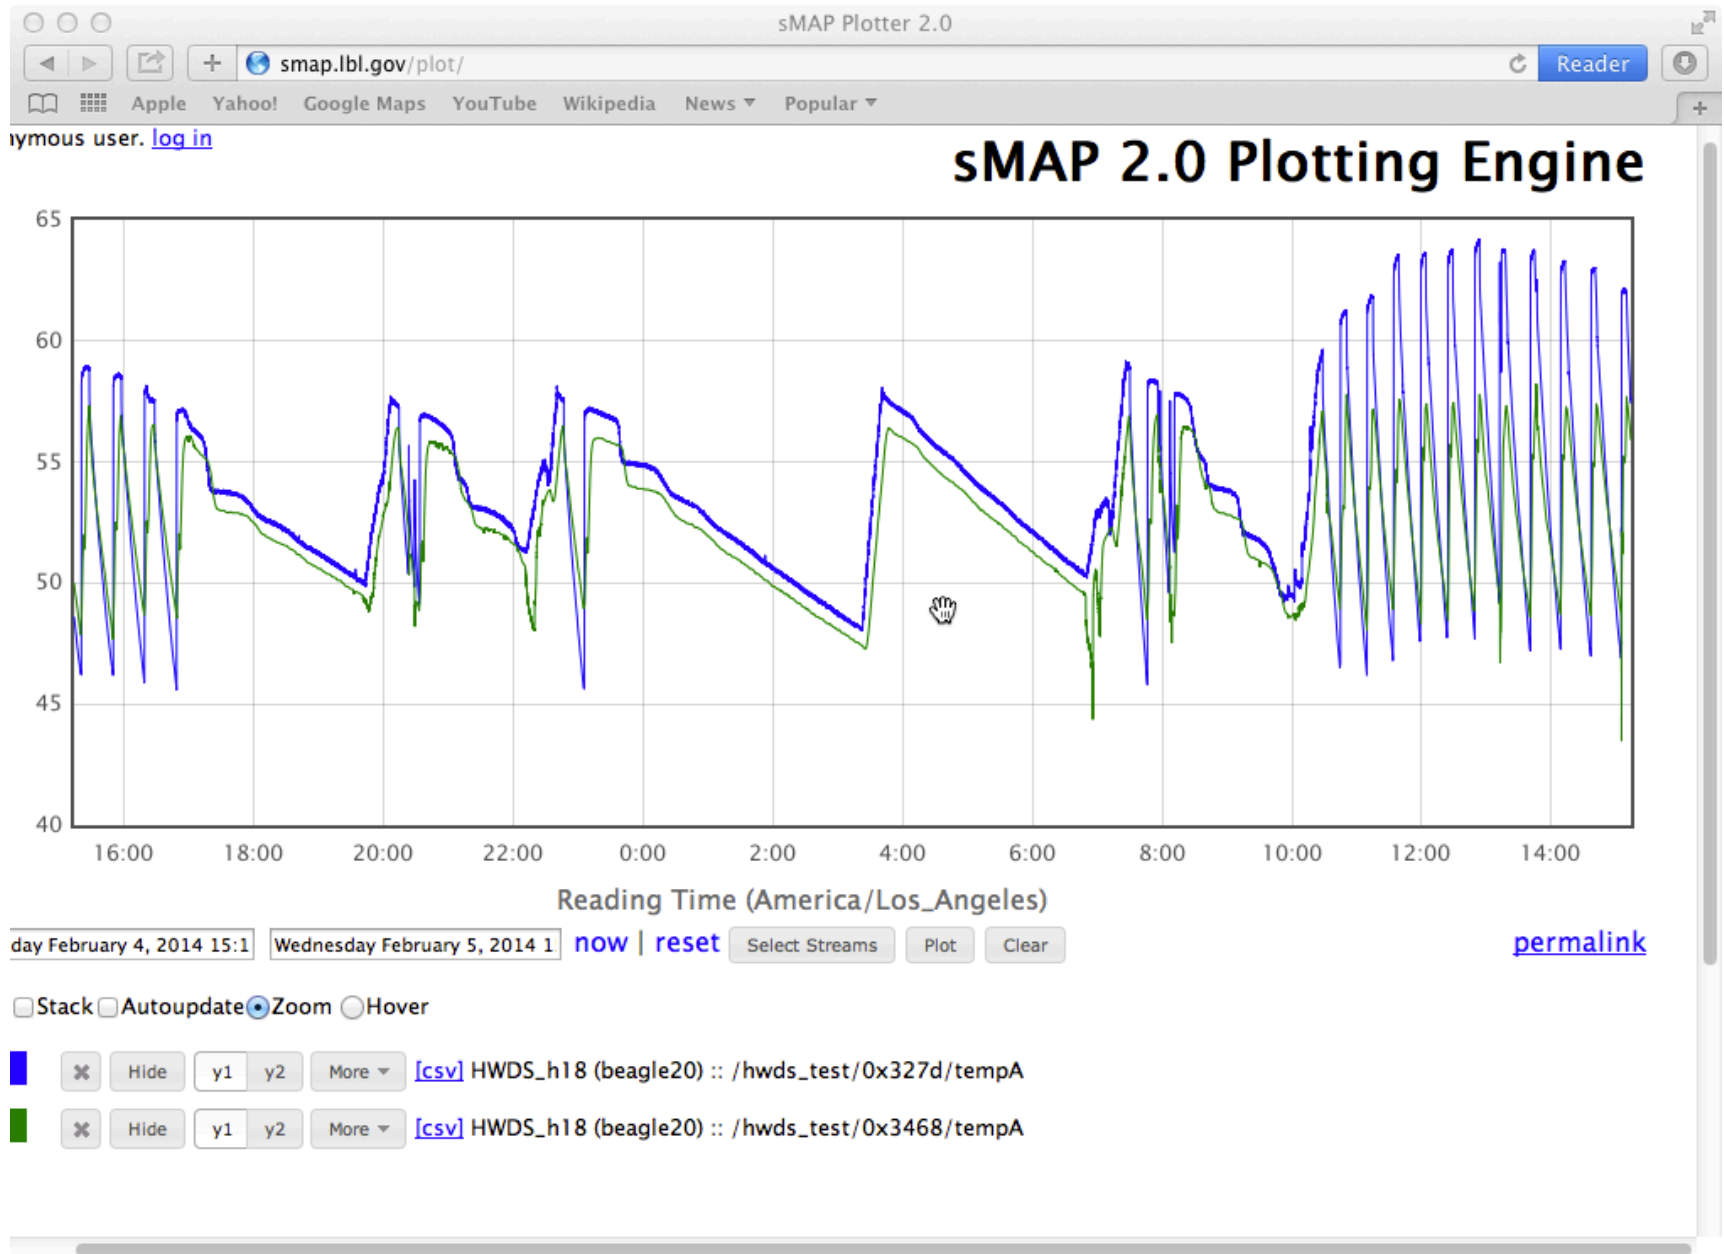

Aquastat: 105-115F, Medium Speed

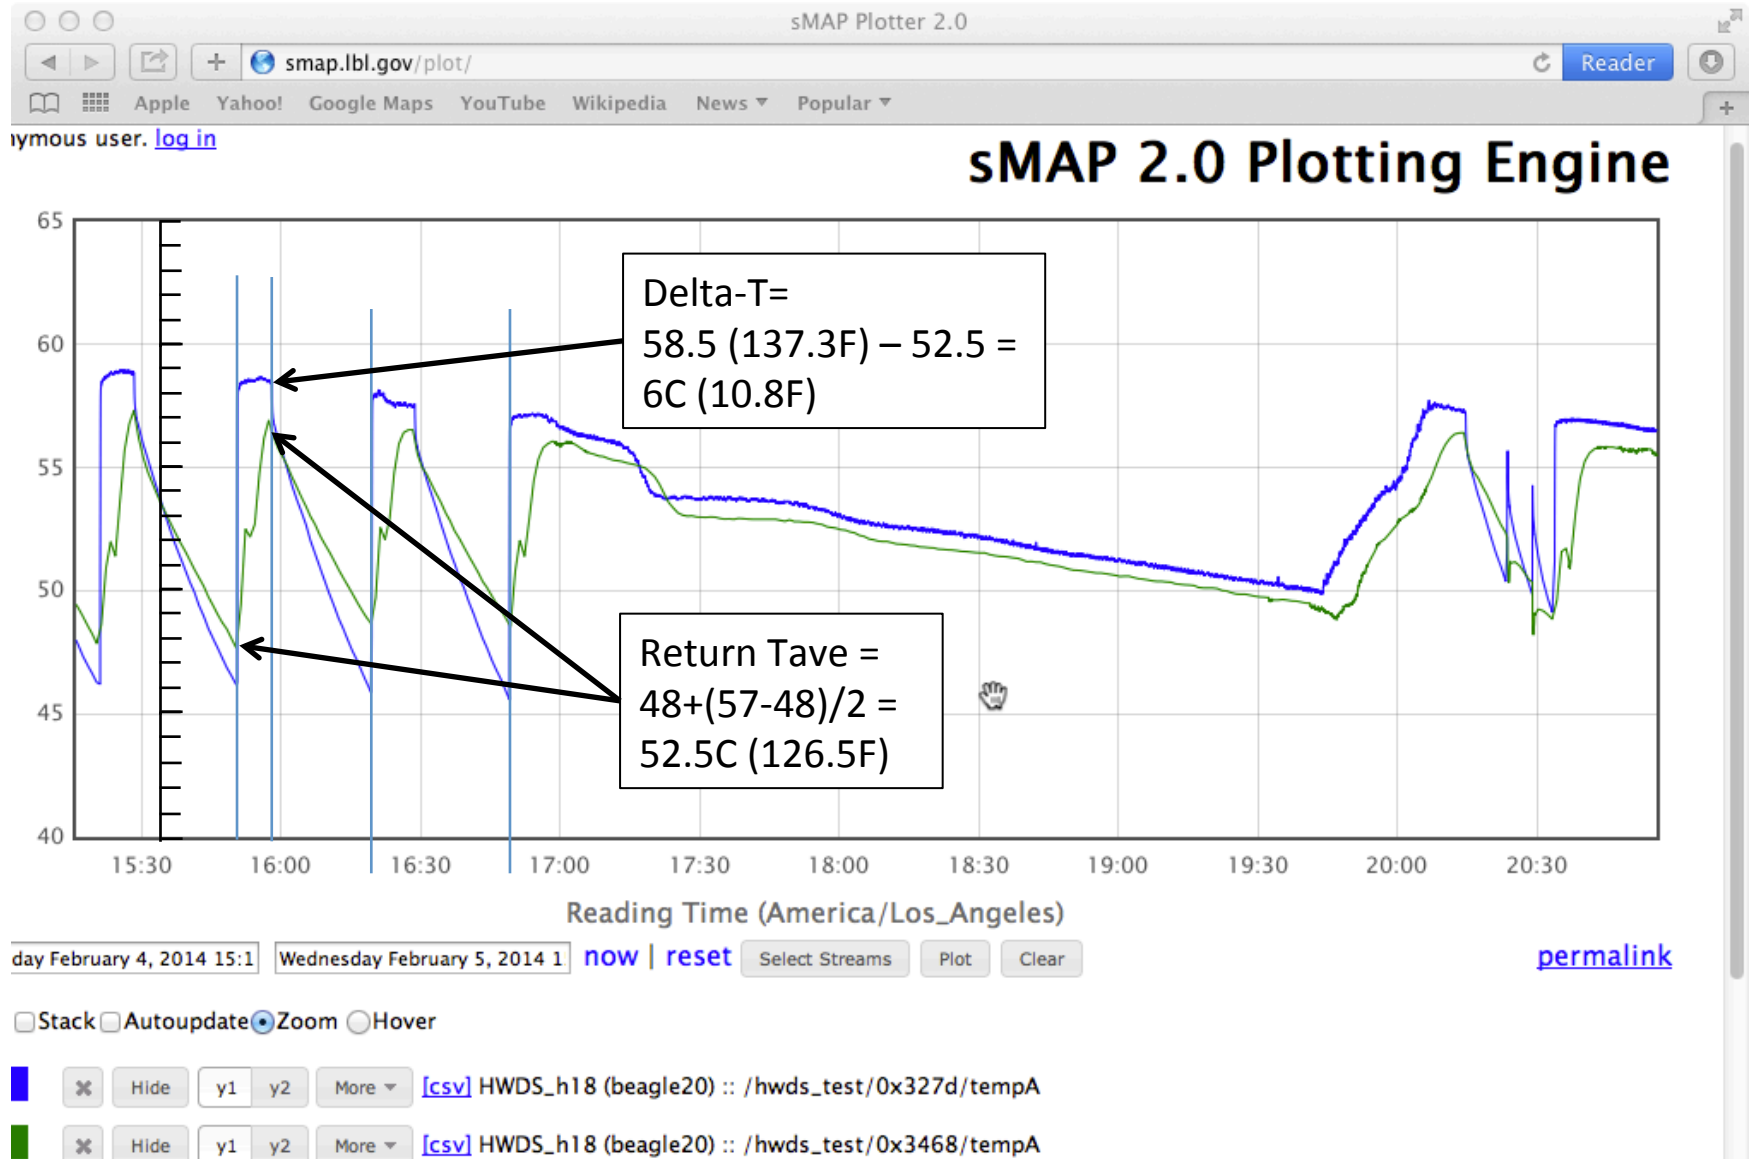


Aquastat: 105-115F, High Speed

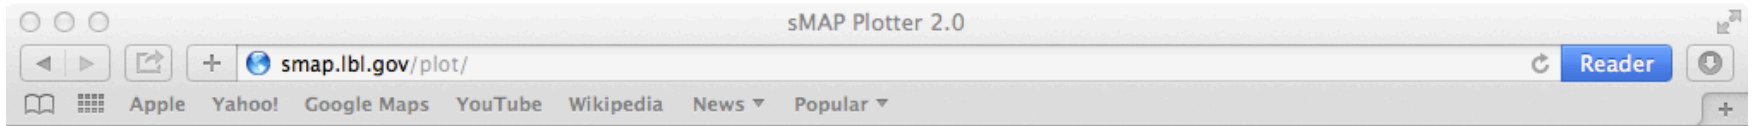

Anonymous user. [log in](#)

sMAP 2.0 Plotting Engine

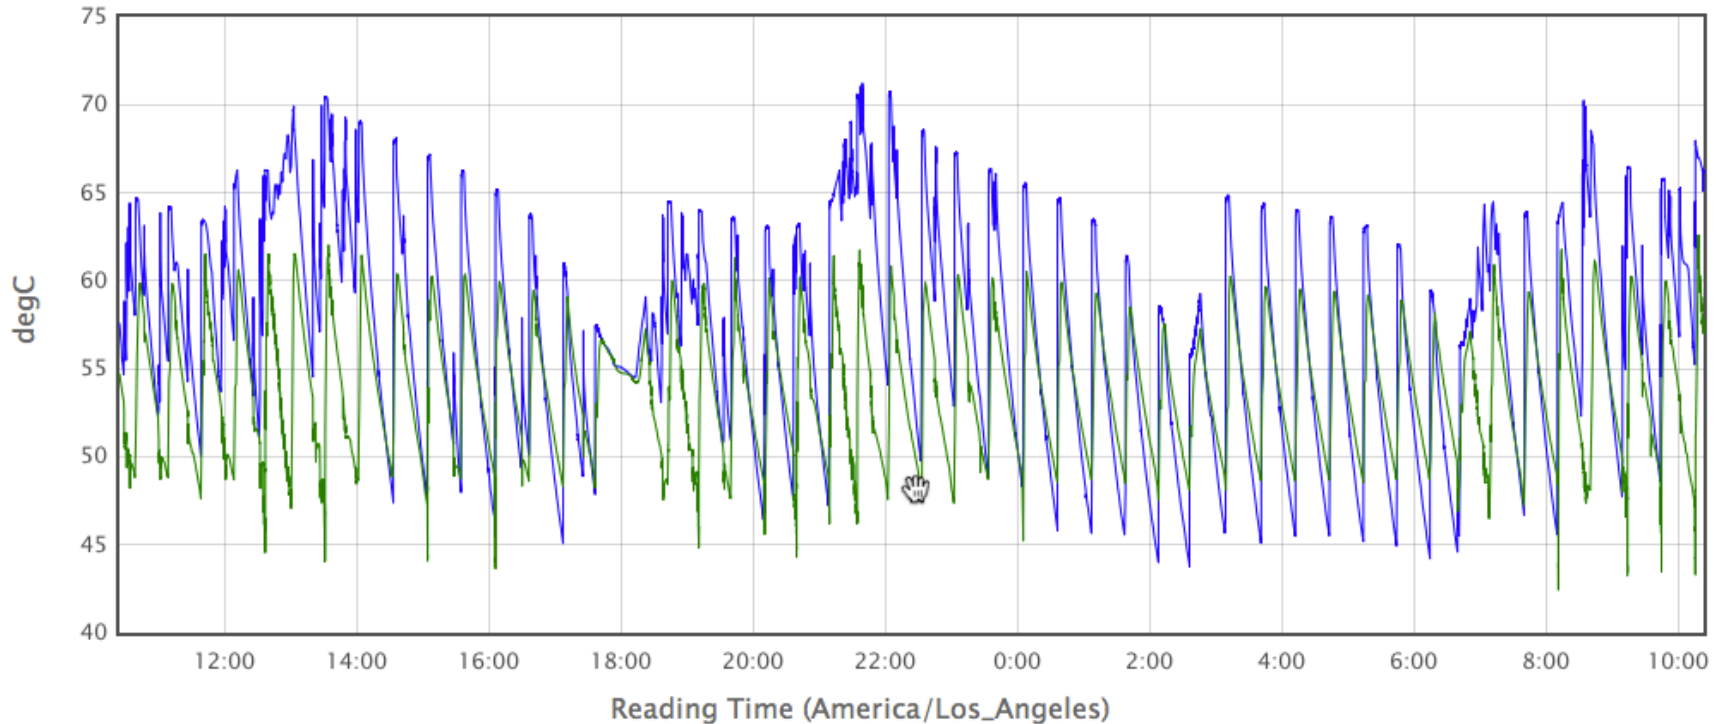

Sunday February 9, 2014 10:23

Monday February 10, 2014 10:23

[now](#) | [reset](#)

Select Streams

Plot

Clear


[permalink](#)

☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover

  Hide y1 y2 More [\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x327d/tempA


  Hide y1 y2 More [\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x3468/tempA

Aquastat: 105-115F, High Speed

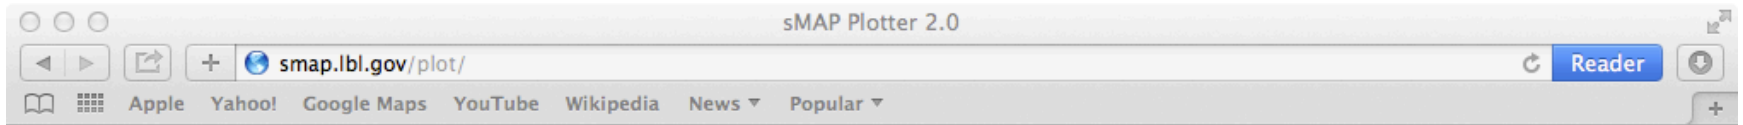

Anonymous user. [log in](#)

sMAP 2.0 Plotting Engine

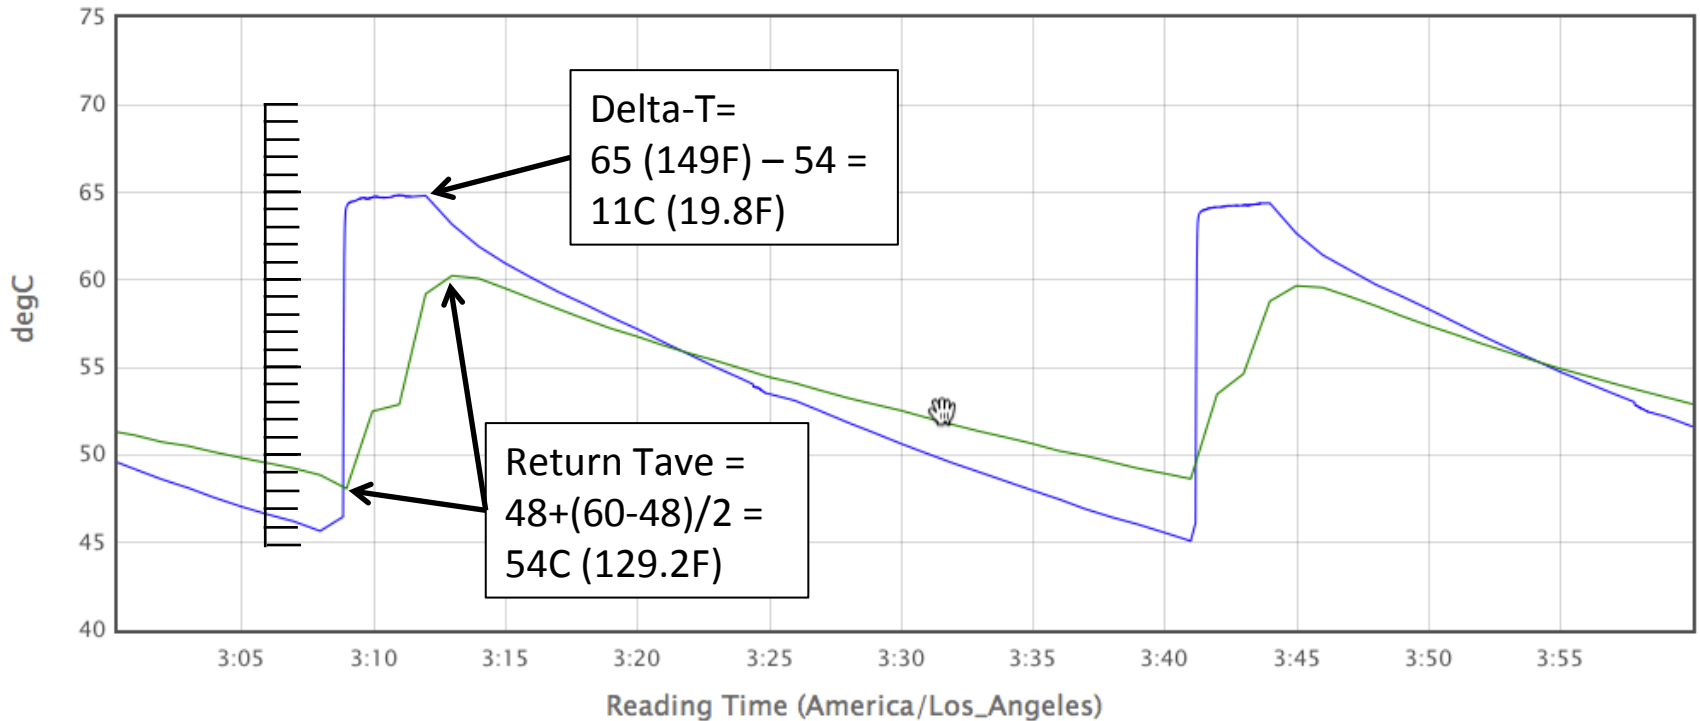

Sunday February 9, 2014 10:23 Monday February 10, 2014 10:23 [now](#) | [reset](#) [Select Streams](#) [Plot](#) [Clear](#)


[permalink](#)

☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover

☒ [x](#) Hide y1 y2 More ▾ [\[csv\]](#) HWDS_h18 (beagle20) :: /hws_test/0x327d/tempA


☒ [x](#) Hide y1 y2 More ▾ [\[csv\]](#) HWDS_h18 (beagle20) :: /hws_test/0x3468/tempA

Demand Controls-Button Activation

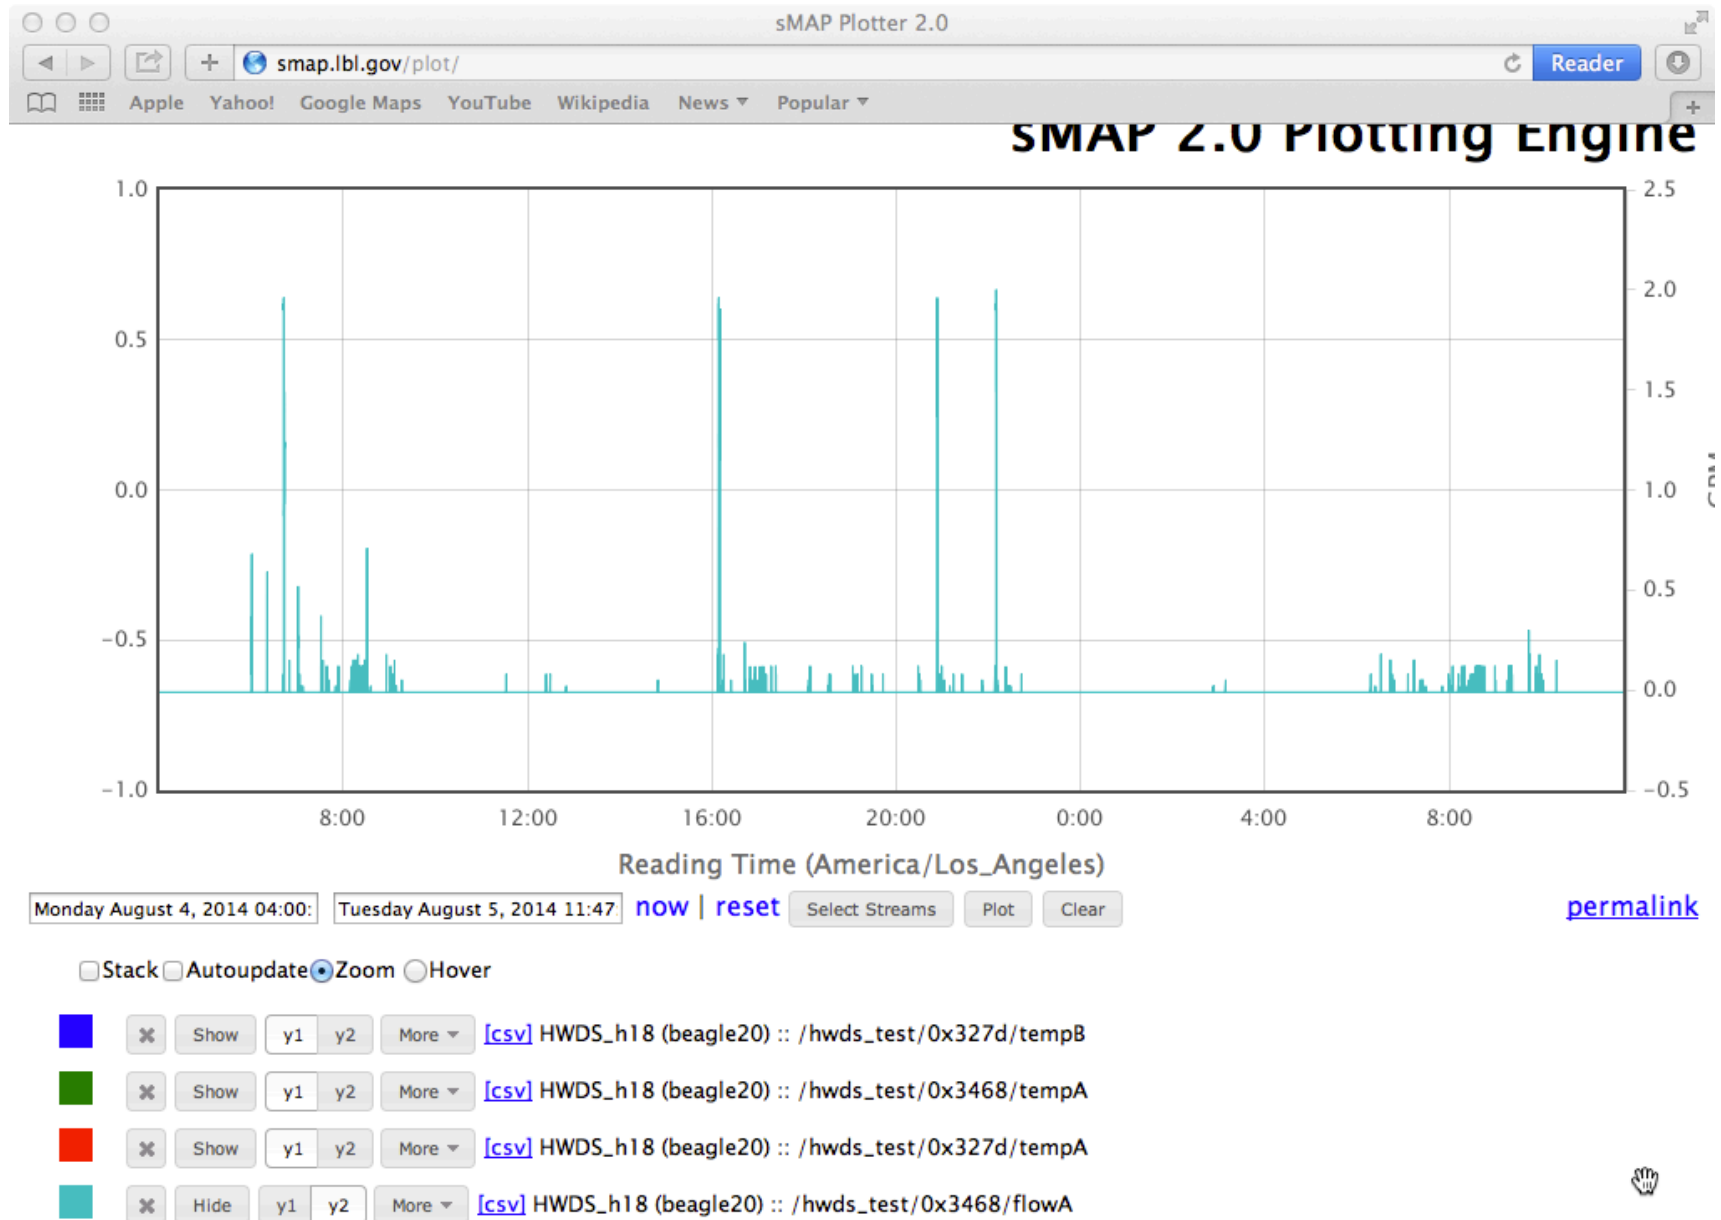

Anonymous user. [log in](#)

sMAP 2.0 Plotting Engine

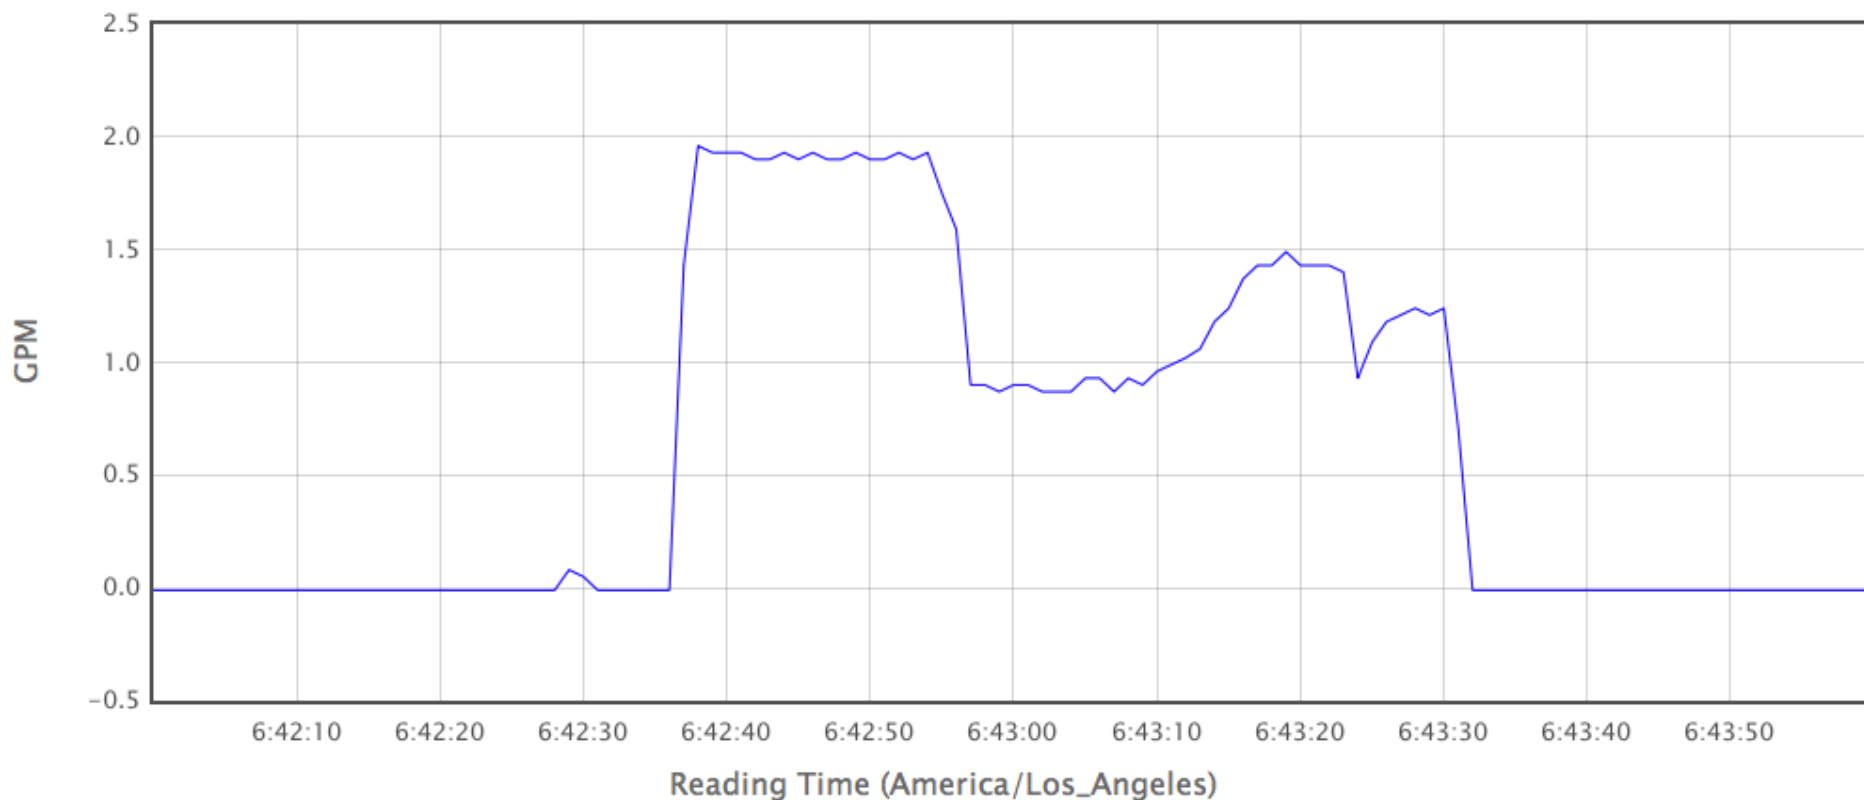

Monday August 4, 2014 04:00:

Tuesday August 5, 2014 11:34

[now](#) | [reset](#)

Select Streams

Plot

Clear

[permalink](#)☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover

Hide

y1


y2

More ▾

[\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x3468/flowA

Anonymous user. [log in](#)

sMAP 2.0 Plotting Engine

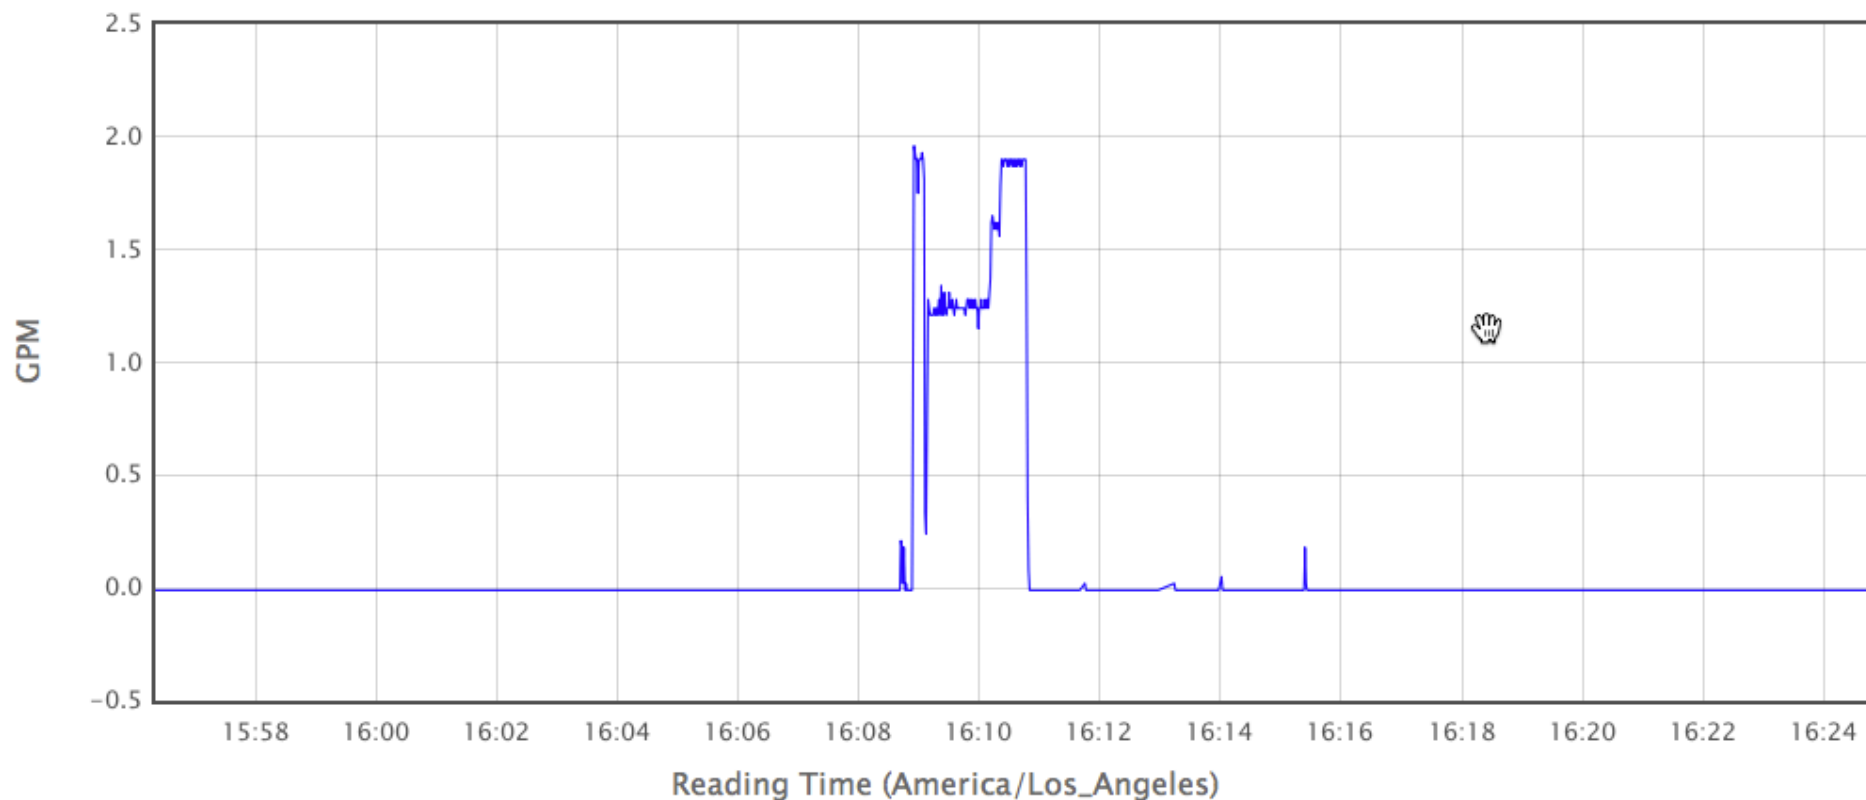

Monday August 4, 2014 07:04:

Tuesday August 5, 2014 07:04:

[now](#) | [reset](#)

Select Streams

Plot

Clear

[permalink](#)☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover

Hide

y1


y2

More ▾

[\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x3468/flowA

Anonymous user. [log in](#)

sMAP 2.0 Plotting Engine

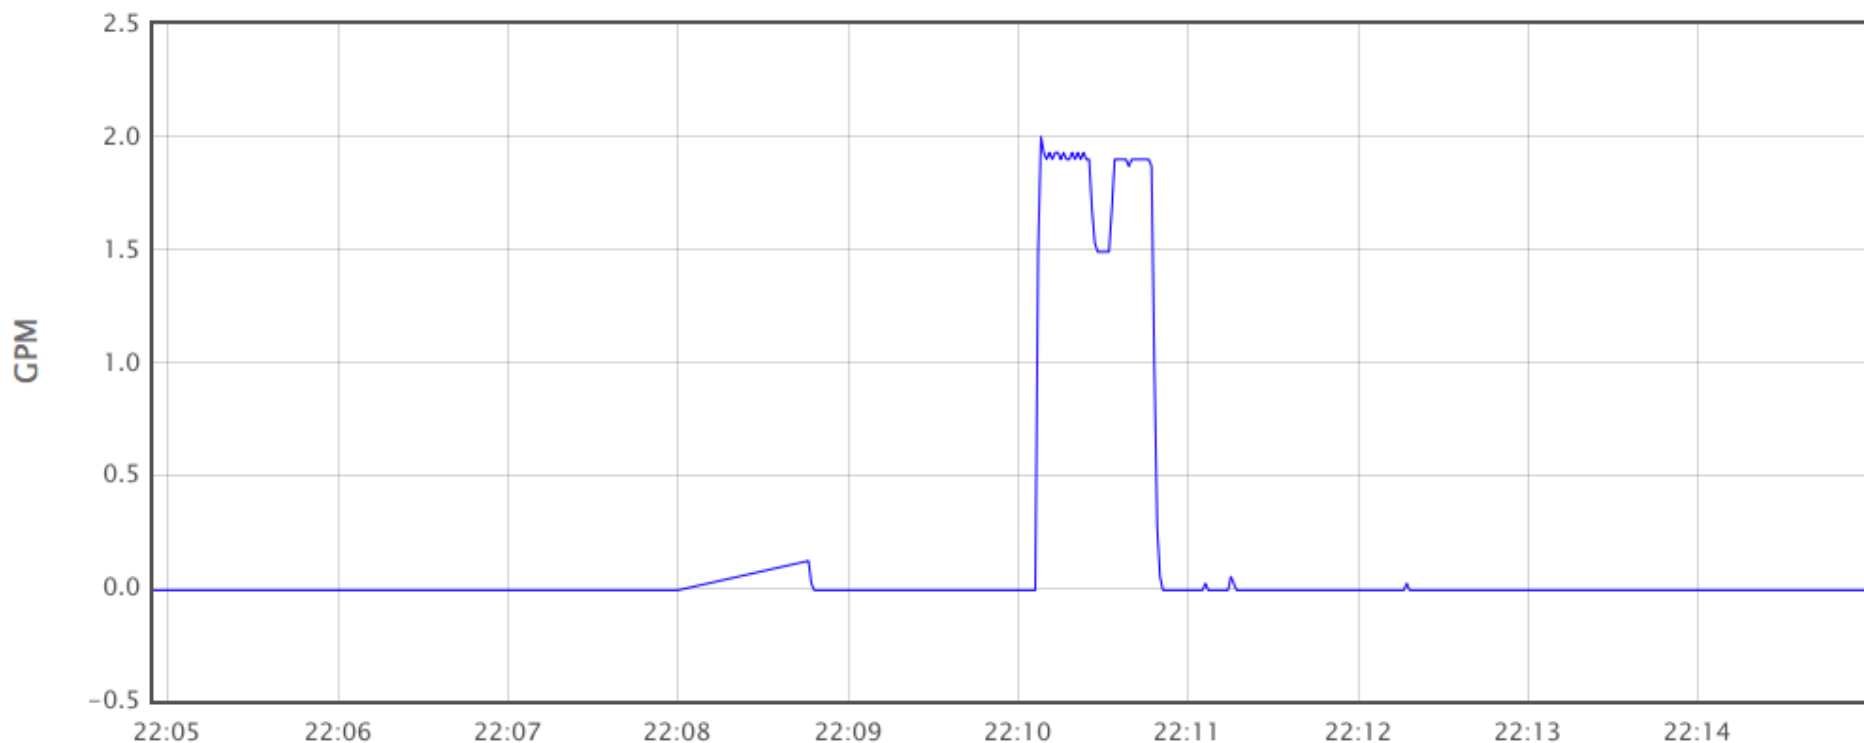

Reading Time (America/Los_Angeles)

Monday August 4, 2014 07:04:

Tuesday August 5, 2014 07:04:

[now](#) | [reset](#)

Select Streams

Plot

Clear

[permalink](#)☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover

Hide

y1


y2

More ▾

[\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x3468/flowA

Anonymous user. [log in](#)

sMAP 2.0 Plotting Engine

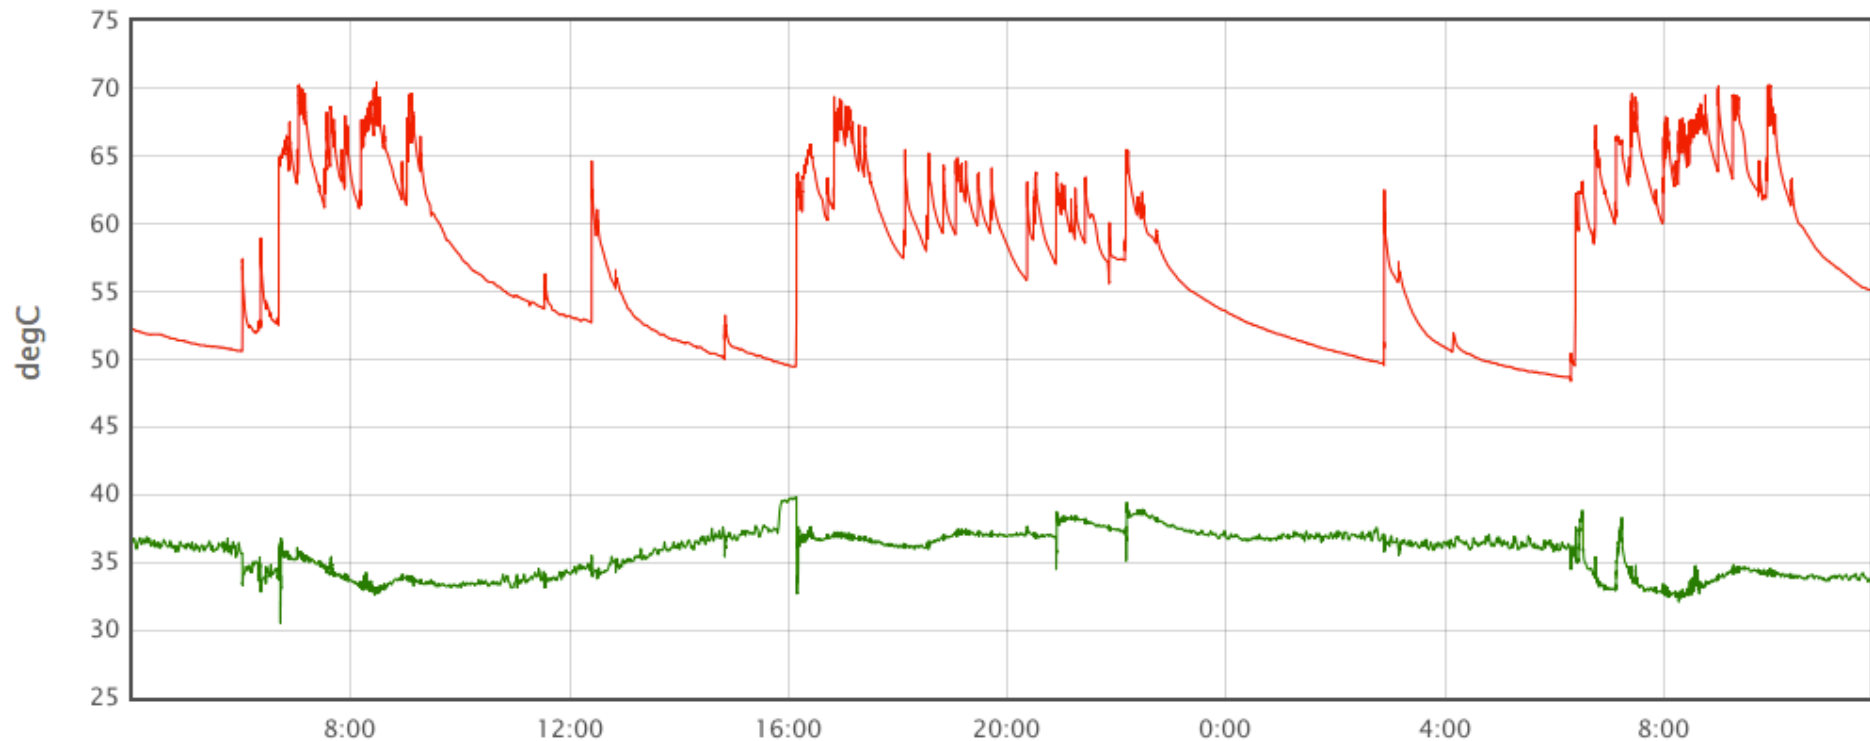


Monday August 4, 2014 04:00:

Tuesday August 5, 2014 11:47

[now](#) | [reset](#)[Select Streams](#)[Plot](#)[Clear](#)[permlink](#)☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover☒ [Show](#) [More](#) [\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x327d/tempB☒ [Hide](#) [More](#) [\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x3468/tempA☐ [Hide](#) [More](#) [\[csv\]](#) HWDS_h18 (beagle20) :: /hwds_test/0x327d/tempA

SMAP 2.0 Plotting Engine

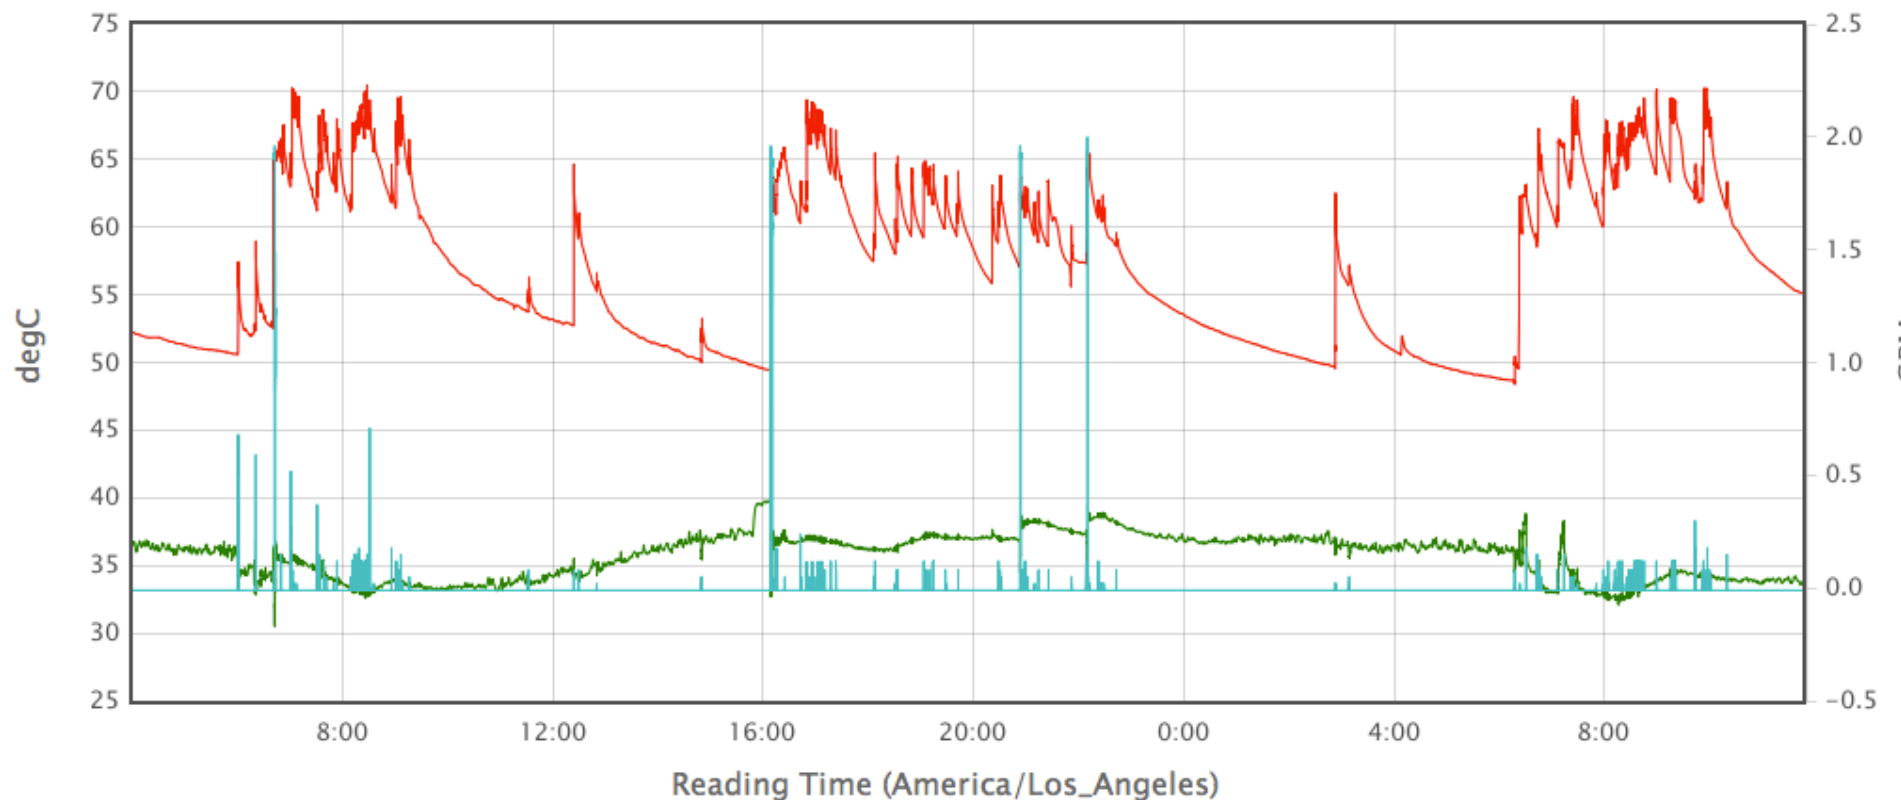[permalink](#)

Monday August 4, 2014 04:00:

Tuesday August 5, 2014 11:47

[now](#) | [reset](#)[Select Streams](#)[Plot](#)[Clear](#)☐ Stack ☐ Autoupdate ☒ Zoom ☐ Hover

- | | | | | | | |
|---|---|----------------------|---------------------------------|---------------------------------|------------------------|---|
|  |  | Show | <input type="text" value="y1"/> | <input type="text" value="y2"/> | More ▾ | [csv] HWDS_h18 (beagle20) :: /hws_test/0x327d/tempB |
|  |  | Hide | <input type="text" value="y1"/> | <input type="text" value="y2"/> | More ▾ | [csv] HWDS_h18 (beagle20) :: /hws_test/0x3468/tempA |
|  |  | Hide | <input type="text" value="y1"/> | <input type="text" value="y2"/> | More ▾ | [csv] HWDS_h18 (beagle20) :: /hws_test/0x327d/tempA |
|  |  | Hide | <input type="text" value="y1"/> | <input type="text" value="y2"/> | More ▾ | [csv] HWDS_h18 (beagle20) :: /hws_test/0x3468/flowA |



Energy Use of Circulation Controls

Strategy	Cycles				Pump		Energy		
	Delta-T	Length	Daily		Flow Rate	Watts	Annual (including Efficiency)		
	(F)	(Min)	Number	Hours	(GPM)		Loop		Pump
							BTU	Therms	kWh
Continuous Circulation									
Medium Speed	3.6	1440	1	24	1.2	25	25,218,708	252	219
Intermittent Pulsed Timer									
Medium Speed	36	5	20	1.7	1.2	25	17,512,992	175	15
Aquastat: Range 85-105F									
Medium Speed	24.3	7	25	2.9	1.2	25	20,687,222	207	27
High Speed	21.6	4.7	25	1.9	1.8	43	18,401,776	184	31
Aquastat: Range 105-115F									
Medium Speed	10.8	5	48	4.0	1.2	25	12,609,354	126	37
High Speed	19.8	3	48	2.4	1.8	43	20,805,434	208	38
Demand Control									
Button Activation	46.8	1.5	5	0.1	1.8	85	2,561,275	26	4

**Given human nature,
it is our job
to provide the infrastructure
that supports efficient behaviors.**

Thank You!

Gary Klein

Gary Klein and Associates

Tel: 916-549-7080

Email: Gary@GaryKleinAssociates.com